


# TAC Vista Product Catalog





## Table of Contents

|   |    |
|---|----|
| <b>About TAC</b> .....                  | 1  |
| <b>System Overview</b> .....            | 5  |
| <b>Software</b> .....                   | 9  |
| <b>Vista 5</b> .....                    | 10 |
| Introduction.....                       | 10 |
| TAC Vista 5 Server.....                 | 11 |
| TAC Vista 5 Workstation.....            | 12 |
| TAC Vista 5 Report Generator.....       | 13 |
| TAC Vista 5 Signature.....              | 13 |
| TAC Vista 5 Graphic Editor OGC.....     | 14 |
| TAC Vista 5 Graphic Editor TGML.....    | 14 |
| TAC Vista 5 Database Generator.....     | 15 |
| TAC Vista 5 Communication SYSTEM 7..... | 15 |
| TAC Vista 5 OPC Client.....             | 15 |
| TAC Vista 5 OPC Server.....             | 16 |
| TAC Vista 5 CIPCL Editor.....           | 16 |
| TAC Vista 5 IPCL Editor.....            | 16 |
| TAC Vista 5 OPC Tool.....               | 17 |
| TAC Vista 5 Webstation.....             | 17 |
| TAC Vista ScreenMate.....               | 18 |
| TAC Vista Host Tool.....                | 18 |
| LNS Server.....                         | 18 |
| <b>Vista FM</b> .....                   | 19 |
| TAC Vista FM.....                       | 19 |
| <b>Engineering Tools</b> .....          | 20 |
| TAC Menta.....                          | 20 |
| TAC ZBuilder.....                       | 21 |
| TAC XBuilder.....                       | 22 |
| TAC OPC Tool.....                       | 22 |
| LonMaker® Network Management Tool.....  | 23 |

|   |    |
|---|----|
| <b>Hardware</b> .....   | 25 |
| <b>Ethernet Devices</b>   |    |
| Introduction .....  | 26 |
| TAC Xenta 511/511-B .....   | 27 |
| TAC Xenta 527 .....   | 28 |
| TAC Xenta 913 .....   | 29 |
| TAC Xenta 911 .....   | 31 |
| TAC Xenta 700 .....   | 32 |
| <b>Programmable Controllers</b>   |    |
| Introduction .....  | 34 |
| TAC Xenta 280 .....   | 36 |
| TAC Xenta 300 Stand Alone .....   | 37 |
| TAC Xenta 300 Base Unit .....   | 38 |
| TAC Xenta 401 and 401:B Base Unit .....   | 39 |
| TAC Xenta 411/412 Digital Input Module .....  | 40 |
| TAC Xenta 421A/422A Universal Input and Digital Output Module .....                 | 41 |
| TAC Xenta 451A/452A Universal Input and Analog Output Module .....                  | 42 |
| TAC Xenta 471 Analog Input Module .....   | 43 |
| TAC Xenta 491/492 Analog Output Module .....  | 44 |
| TAC Xenta OP Operator Panel .....   | 45 |
| <b>Zone Controllers</b>   |    |
| Introduction .....  | 48 |
| TAC Xenta 101-VF Fan Coil Unit Controller .....                                     | 50 |
| TAC Xenta 102-B, 102-EF, 102-VF VAV Controllers .....                               | 51 |
| TAC Xenta 102-ES VAV Controller (valve reheat) .....                                | 52 |
| TAC Xenta 102-AX VAV Controller with Onboard Actuator and Air flow Transducer ..... | 53 |
| TAC Xenta 103-A Chilled Ceiling Controller .....                                    | 54 |
| TAC Xenta 104-A Roof Top Unit Controller .....                                      | 55 |
| TAC Xenta 110-D Dual Zone Controller .....  | 56 |
| TAC Xenta 121-FC Programmable Fan Coil Controller .....                             | 57 |
| TAC Xenta 121-HP Programmable Heat Pump Application .....                           | 58 |
| TAC Xenta OP LONWORKS® Operator Panel .....   | 59 |
| <b>Vista Security</b>   |    |
| Introduction .....  | 62 |
| TAC Xenta 527 .....   | 63 |
| TAC/INET 7790A MicroController Interface .....                                      | 64 |
| TAC 7798 I/SITE LAN Integrated Site Controller .....                                | 65 |
| TAC/INET SCU Security Control Units 1284, 1280, 1200 .....                          | 66 |
| TAC 7798C (SLI) sub-LAN Interface .....   | 67 |

## Network Infrastructure Products

|  |    |
|--|----|
| Introduction.....                            | 70 |
| TAC Xenta 901 Serial LonTalk® Adapter.....   | 71 |
| TAC Xenta 911.....                           | 72 |
| PC LONWORKS® Adapter.....                    | 73 |
| PCMCIA LONWORKS® Adapter.....                | 73 |
| Serial LONWORKS® Adapter.....                | 74 |
| TAC Xenta LONWORKS® Repeater FTT10, 24V..... | 74 |
| Termination.....                             | 75 |
| TAC Xenta 913 LONWORKS®/INET Gateway.....    | 75 |
| NIC-PCI Network Interface.....               | 76 |
| LONWORKS® Terminal Units.....                | 77 |
| LONWORKS® LCD Display.....                   | 78 |
| LONWORKS® Routers.....                       | 79 |
| LPA Protocol Analyzer.....                   | 80 |
| LONWORKS® Network Interfaces, NIC.....       | 81 |
| LONWORKS® (EIA-709) IP Routers Gateway.....  | 82 |

## Operator Panels

|                               |    |
|-------------------------------|----|
| Introduction.....             | 84 |
| TAC Xenta Operator Panel..... | 85 |
| TAC Xenta OP 1500.....        | 86 |

## Air Handling Controllers

|                              |    |
|------------------------------|----|
| Introduction.....            | 88 |
| TAC 2411, 2412 and 2413..... | 89 |
| TAC 2000 Viewer.....         | 90 |

## Heating Controllers

|   |     |
|---|-----|
| Introduction.....                                     | 92  |
| TAC 2112.....   | 93  |
| TAC 2222.....   | 94  |
| TAC 2232.....   | 95  |
| TAC 2242.....   | 96  |
| TAC 2321.....   | 97  |
| TAC 2000 Viewer for TAC 2000 Heating Controllers..... | 98  |
| TA 200.....   | 99  |
| TA 200 OPT Heating Compensator and Optimizer.....     | 100 |
| TA 239W.....  | 101 |



# About TAC

Open Systems for Building IT®



# Global Leader in Building IT




Ratheon, St. Petersburg, Florida, USA

TAC is a leading provider of building automation solutions based on Open Integrated Systems for Building IT. TAC's mission is to provide added value through building environment services for indoor climate, security and use of energy, delivered with advanced technology to end users and property owners throughout the world. With over 80 years of experience in the HVAC, building automation and security arenas, TAC employs more than 5,000 people worldwide, with partners and branches in 80 countries. TAC's parent company, Schneider Electric, is the world leader in automation and electricity management, with over 90,000 employees worldwide and operations in 130 countries.

TAC is the fastest-growing, most innovative company in the building automation industry. We are at the forefront of growth because we deliver what our customers want, year after year, building after building.

## WHAT MAKES TAC THE LEADER?

- Fastest-growing, most innovative in the industry
- Delivering "customer for life" services and benefits
- Taking open, integrated systems to a new level
- Technical and market leadership
- World-class market representation

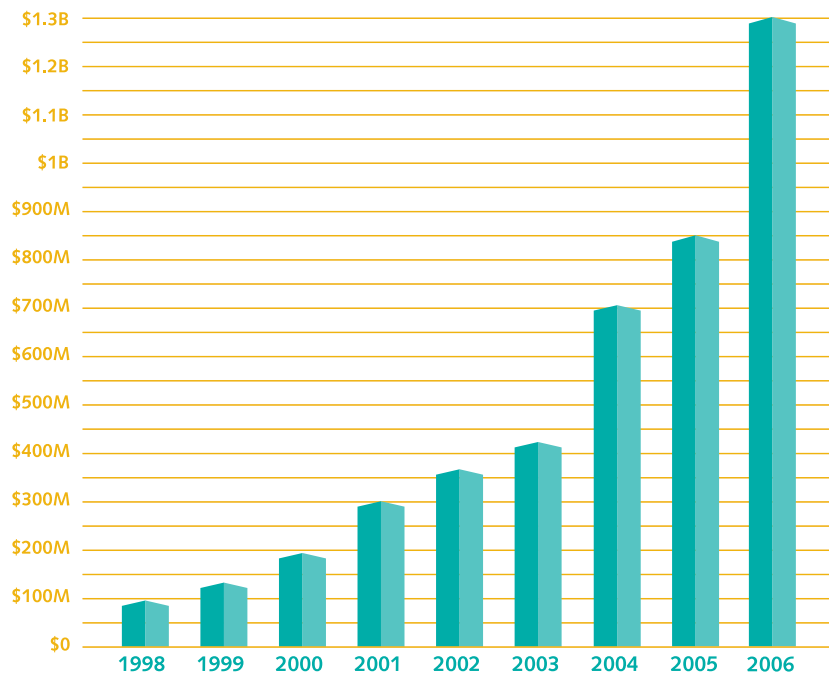





Capricorn Building, Düsseldorf, Germany

#### THE ADVANTAGES OF “OPEN INTEGRATED SYSTEMS FOR BUILDING IT”

Our open, standard technology enables you to integrate heating and cooling, access control, security monitoring, ventilation, fire and smoke control and lighting, across your enterprise. This approach reduces training and maintenance costs, increases energy savings, and adds value by collecting and sharing vast amounts of pertinent facility and financial data, which helps you run a more profitable building. You have full control of an entire building — or multiple buildings, or each room in each building — from a single user interface. Better control translates directly into such benefits as savings, flexibility, security, reduced expenses, more attractive properties and user-friendly operation. Even employee productivity improves, because people feel and function better as a direct result of improved indoor climate.

Open systems also provide the freedom to create new innovative solutions. Because we use standard, non proprietary technology such as TCP/IP, LONWORKS®, BACnet® and Ethernet, our solutions are compatible with virtually all systems on the market, and can fully integrate on one network. This gives you more options and prevents you from being locked in with any one vendor's technology.

#### HOW DO WE DELIVER OUR SOLUTIONS?

We deliver solutions through a world-class organization that covers all continents. We are proud to claim premier systems integrators as our partners to market. Along with our branch offices, they deliver solutions throughout the world, tailored to the needs of each facility, region and industry.

#### Support and Energy Optimization

We are committed to supporting our customers' facilities and to ensuring optimum energy performance throughout the entire life-cycle of their buildings.

We offer a comprehensive range of vital monitoring, energy efficiency and support services tailored to your specific operational needs, including:

- A full array of performance contracting services
- Energy efficiency programmes that address all aspects of energy use
- 24/7 telephone support and remote management services
- Low cost and no cost energy conservation measures
- Comprehensive user training
- Technical help desk
- Software upgrades and migration paths
- Adjustment and optimization of installed systems
- Regular inspection and function testing
- Call-out maintenance




# System Overview

Providing Solutions Enabled by Open  
Systems for Building IT®



## VISTA SYSTEM ARCHITECTURE

All TAC® products incorporate the TP/FT-10 Free Topology Transceiver

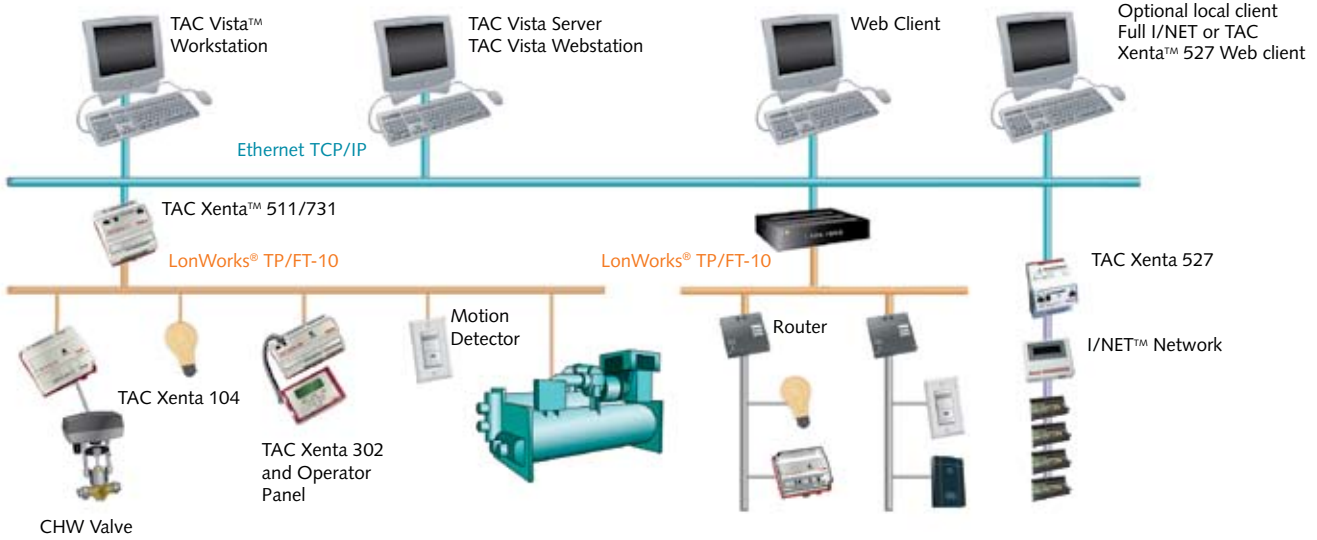

### TAC VISTA INTEROPERABLE OPEN SYSTEMS CREATE SEAMLESS INTEGRATION

To satisfy the accelerating building control requirements of today's building owners and occupants, the controls industry focuses on information technology for building management – Building IT.

By merging communications, data collection, information sharing and networking into a single, interoperable system, TAC Vista creates efficient, economical building control solutions that fit seamlessly with other products based on open system architecture.

Combining industry-standard technology with an easy-to-use interface, TAC Vista produces an integrated building management solution that is reliable, flexible and cost-effective. Full integration of environmental control as well as facility and energy management in a single software package allow you to customize TAC Vista for any building and security management application.

### OPEN SYSTEM FOR OPEN CHOICE

TAC Vista is based on totally open architecture, which gives customers freedom of choice in selecting products from a wide range of suppliers, yielding true vendor independence. TAC Vista runs on Microsoft® Windows® with standard LAN communication on Ethernet® or fiber optics using TCP/IP and standard network equipment. Field bus communication features the open LONWORKS® technology, which is used by more than 3,000 vendors worldwide.



National Physical Laboratory, United Kingdom

### TCP/IP OFFERS A VARIETY OF NETWORKING ARCHITECTURE OPTIONS

Using TCP/IP, TAC Vista host workstations can communicate across the Internet and existing commercial WAN/LANs.

### TAC VISTA'S FLEXIBLE ARCHITECTURE MAKES IT HIGHLY SCALABLE

TAC Vista is eminently suited for any building management application, regardless of the building size, the number of buildings or what distances separate the buildings. TAC Vista manages multi-campus office parks and district-wide school systems just as efficiently as single, small office buildings.

## YOU WILL ALWAYS KNOW WHAT IS HAPPENING WITHIN YOUR CONTROL SYSTEM

Alarms and historical logs provide system monitoring that is both reliable and flexible. TAC Vista operators can respond to critical alarms in seconds. The receipt of an alarm can even automatically display a specific system page, giving the operator quick, graphical access to the situation.

### TAC VISTA

TAC Vista is the software solution that efficiently controls, checks and analyzes the daily operation and economical running of a building. TAC Vista is available in a variety of packages designed to maximize efficiency and economy. TAC Vista is also modular, making it easy to expand the system as your needs change. Also, TAC Vista is available in an increasing number of languages.

### TAC VISTA SERVER AND WORKSTATION


TAC Vista Server provides access to the environmental and security controls for operator workstations, and is the primary operator interface to the control system. It displays daily operations through a graphical user interface, providing operators with ready access to alarms, historical logs and sophisticated data trend logs as well as standard and custom reports.

### TAC VISTA WEBSTATION


Webstation allows access to the control system using common web browsers. Using any web browser, users can navigate their site, view graphics and trend charts and manage alarms. Webstation provides access to trace events in the system, and the Webstation server provides access to periodic or automatic reports.

### TAC VISTA SCREENMATE

The main task of the TAC Vista ScreenMate is to replace the functionality found in sophisticated room thermostats. ScreenMate makes it possible for users to read and make personal changes to settings such as the room temperature setpoint or to view the outside air temperature directly from the user's PC. The ScreenMate solution is based on standard web technologies and can be accessed from any client device with a web browser.

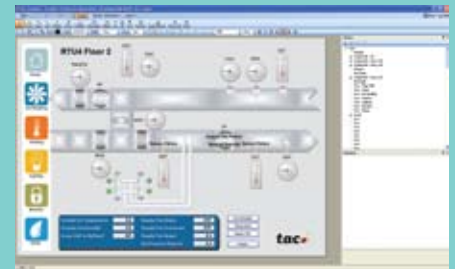


Monitor all aspects of how your building operates

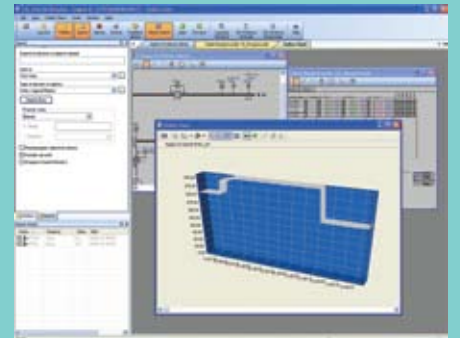

Analyze to improve building performance



Control your environment from your desktop

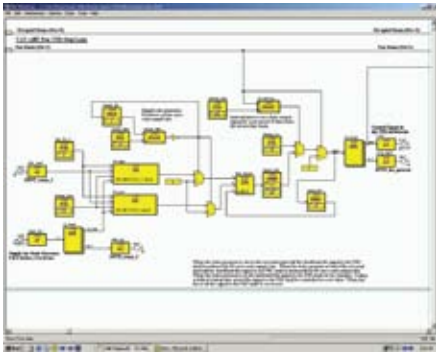

### TAC MENTA™

TAC Menta is the programming software tool for the TAC Xenta™ controllers. You will save time and improve operational reliability with this engineering tool for HVAC applications.

TAC Menta:

- Provides many pre-programmed function blocks and basic application elements
- Monitors offline simulations and online testing with an integrated trend log

### TAC XENTA

All TAC Xenta controllers provide open, future-proof system architecture. TAC Xenta controllers provide access to a standardized LONWORKS®-based network technology supporting a flexible control system to which components from other manufacturers can be connected.

The TAC Xenta 100 line consists of LONMARK®-certified zone controllers designed for specific applications such as fan coil, VAV, chilled ceiling and rooftop air handling units.

The TAC Xenta 280 and 300 series of LONMARK®-certified programmable controllers are intended for any type of plant room control applications.

The LONMARK®-certified TAC Xenta 401 controller and the TAC Xenta 400 I/O modules are programmable and intended for larger applications.

The TAC Xenta 511 is a cost-effective method of monitoring small-scale LONWORKS-based networks. The TAC Xenta 511 works like any web server, making it easy to monitor and control operations over the Internet.

The TAC Xenta 911 is an Ethernet communication device that lets you communicate with your LONWORKS network over TCP/IP.

The TAC Xenta 913 is a multi-protocol gateway bridging the gap between different protocols and communication technologies – e.g. linking BACnet™, MODBUS® or M-bus to LONWORKS.

The TAC Xenta 527 is a cost-effective method of integrating the I/NET security system into TAC Vista.

The TAC Xenta 700 series is a multifunctional presentation and control system with an embedded web server that allows you to access your control application and control networks via a web browser any time and anywhere in the world.



# Software





# TAC Vista 5

## Vista 5 Packages

The TAC Vista software suite is delivered in the following software installation packages:

- TAC Vista Standalone
- TAC Vista Standard
- TAC Vista Manager
- TAC Vista Professional
- TAC Vista Enterprise

Please refer to the table below for the package contents.

| Software     |                         | Packages                     |                            |                           |                                |                              |
|--------------|-------------------------|------------------------------|----------------------------|---------------------------|--------------------------------|------------------------------|
| Part. No.    | Title                   | Standalone<br>(0-008-8200-0) | Standard<br>(0-008-8201-0) | Manager<br>(0-008-8202-0) | Professional<br>(0-008-8203-0) | Enterprise<br>(0-008-8204-0) |
| 0-008-8220-0 | Workstation             | ▼                            | ▼                          | ▼                         | ▼                              | ▼                            |
| 0-008-8221-0 | Graphics Editor OGC     |                              |                            |                           | ▼                              | ▼                            |
| 0-008-8222-0 | Graphics Editor TGML    |                              |                            |                           | ▼                              | ▼                            |
| 0-008-8223-0 | Report Generator        |                              |                            | ▼                         | ▼                              | ▼                            |
| 0-008-8224-0 | OPC Tool                |                              |                            |                           |                                |                              |
| 0-008-8225-0 | IPCL Editor             |                              |                            |                           |                                |                              |
| 0-008-8226-0 | Central IPCL Editor     |                              |                            |                           |                                |                              |
| 0-008-8227-0 | Database Generator      |                              |                            |                           |                                |                              |
| 0-008-8228-0 | I/NET Integrated        |                              |                            |                           |                                |                              |
| 0-008-8229-0 | I/NET Security          |                              |                            |                           |                                |                              |
| 0-008-8230-0 | Signature               |                              |                            |                           |                                |                              |
| 0-008-8240-0 | Menta 5                 |                              |                            |                           | ▼                              | ▼                            |
| 0-008-8241-0 | XBuilder 5              |                              |                            |                           |                                |                              |
| 0-008-8242-0 | ZBuilder                |                              |                            |                           |                                |                              |
| 0-008-8250-0 | Vista Server            | ▼ <sup>1</sup>               | ▼                          | ▼                         | ▼                              | ▼                            |
| 0-008-8251-0 | OPC Client              |                              |                            |                           |                                |                              |
| 0-008-8252-0 | System 7                |                              |                            |                           |                                |                              |
|              | Webstation <sup>3</sup> |                              |                            |                           |                                | ▼ <sup>2</sup>               |
|              | ScreenMate <sup>3</sup> |                              |                            |                           |                                |                              |

1) Limited server.

2) Three Client Access Licenses, CALs (0-008-8271-0).

3) See product datasheet for part numbers for various license packages.

Maintenance agreements are available for most TAC Vista software modules ( part numbers are given on the following pages). An active maintenance agreement ensures that the licensee has access to any new, minor and major, versions. Maintenance agreements are automatically renewed at the end of each 12 month period. The termination notice is three months.



# TAC Vista 5

## TAC Vista 5 Server

The TAC Vista 5 Server communicates with TAC Xenta controllers or with any LONWORKS® product using SNVTs (Standard Network Variable Types).

Connection for remote monitoring and/or remote control of TAC systems is by a PC LonTalk® adapter or a dedicated/dial-up line. Geographically remote systems can be connected via a modem. Automatic bi-directional dial-up (Auto Dial) is used for requests, changing values and for transferring alarms.

### DATA STORAGE KERNEL FOR THE FOLLOWING FUNCTIONS

- Network management in a multistation system
- Database Management
- Alarm Handling
- Authority/Security
- Backup
- Scheduling
- Trend Logging
- Event Logging
- Central IPCL
- System Administration

### DESCRIPTION

0-008-8250-0 New License

0-008-8350-0 Upgrade

0-008-8450-0 1 Year Maintenance Agreement

## TAC Vista 5 Workstation

Basic software module with color graphics, alarm handling, authority/security, scheduling, trend logging and data backup functionality.

### COLOR GRAPHICS

- Dynamic color graphics
- Display and control
- Hierarchical image links
- Real time data acquisition
- Simultaneous display of several graphics on one screen
- Dynamic trend curves

### ALARM HANDLING

- Alarm and status monitoring
- Color-coded alarm display with information text
- Time and/or event-controlled alarm output on one or several printers
- 1000 alarm priority levels
- Real time error message processing
- Alarm interlocking
- Selection and sorting options for alarm summary
- Alarm links to reports, color graphics, trend charts and text files
- Alarm repetition block
- Error report statistics
- Audible and visual alarm reports
- Error report acknowledgement

### ACCESS CONTROL


- User identification
- Specified access authorization for all users
- Standby log out function
- Automatic log out function
- Encrypted passwords and NT security

### BACKUP

- Seamless recording of all system data

### TIME SCHEDULE

- Automatic daylight savings correction
- Automatic leap year function
- Weekly and alternative time programs
- System time synchronization

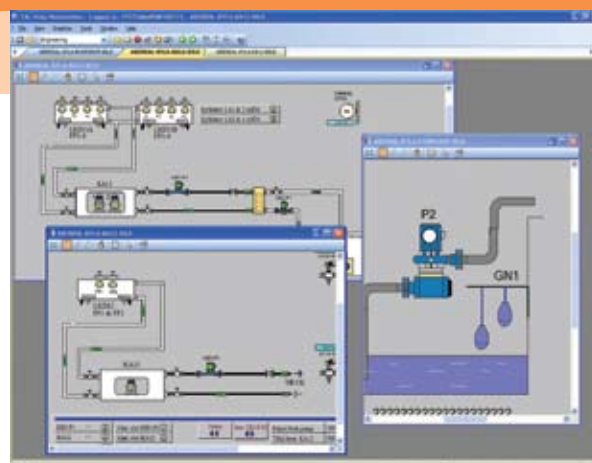

### TREND VIEWER

- Variety of calculation functions
- Time and event controlled activation
- Post editing option of recorded values
- Recording interval of 10 seconds to 10 years
- Dynamic trend curves
- Graphic display and evaluation of online values and trend logs
- Easy operation based on the Microsoft® Windows® standard
- Export of values to other applications such as Microsoft® Excel®
- Variety of graphical presentation options

### EVENT VIEWER

- Acquisition and storage of all events that occur in the system (system diary)
- Chronological acquisition of event data within the system when entering date, time, command carried out and the corresponding user
- Recording of events and commands
- Clearly arranged display of event data

### SYSTEM DOCUMENTATION

- System configuration
- Process units
- Object list
- Data point list
- Data point checklist
- Fixed values

### EXPLORER

- User friendly navigation tool

### DESCRIPTION

0-008-8220-0 New License

0-008-8320-0 Upgrade

0-008-8420-0 1 Year Maintenance Agreement

Maintenance Agreements - see page 10 for further details.

## TAC Vista 5 Report Generator

Software module that independently generates clear and informative reports and overviews, such as alarm and maintenance reports, status reports, trend logging reports as well as special user-defined reports, diagrams and overviews.

- Standard software based on Microsoft® Excel®
- Form and content presentation can be freely configured
- Wide range of options for editing acquired data
- Complete support for Microsoft Excel presentation options such as lines, bars and pie charts
- Report printing on demand, or as scheduled
- Wide range of options for text entry, preparation of graphics and calculation
- Standard formats or customized reports
- Display on screen or printed to one or several printers

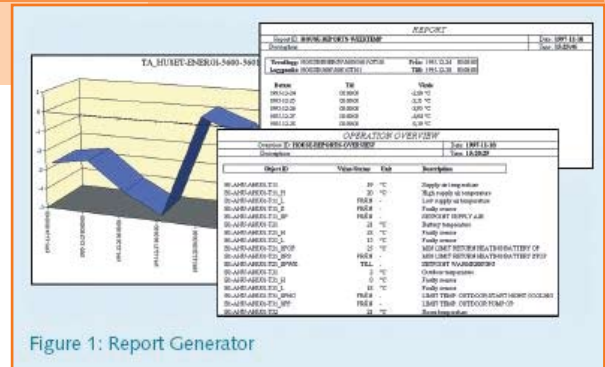


Figure 1: Report Generator

### DESCRIPTION

- 0-008-8223-0 New License
- 0-008-8323-0 Upgrade
- 0-008-8423-0 1 Year Maintenance Agreement

## TAC Vista 5 Signature

Stand-alone energy management software for the optimal analysis of large data volumes.

- Dynamic data exchange or manual data entry
- Budget management and control
- Energy profiles
- Energy usage reports
- Degree days calculation
- Consumption can be displayed based on a range of parameters


### DESCRIPTION

- 0-008-8330-0 Upgrade
- 0-008-8430-0 1 Year Maintenance Agreement

## TAC Vista 5 Graphics Editor OGC

A high performance stand-alone software module for creating and editing dynamic system images. A broad range of drawing tools, symbols and functions allows customized and efficient color graphic creation.

- Extensive standard symbol library
- Symbol editor
- Run time simulation
- Unrestricted tool positioning
- Multiple graphics
- Import of .bmp .gif .jpg .pcx .tif graphics files
- Dynamic and animated graphics as well as creation of dynamic links

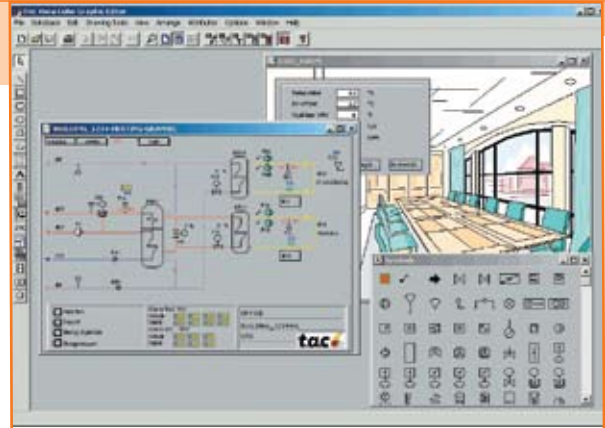

### DESCRIPTION

0-008-8221-0 New License

0-008-8321-0 Upgrade


0-008-8421-0 1 Year Maintenance Agreement

## TAC Vista 5 Graphics Editor TGML

TGML is the enhanced Vista graphics system. The editor for TGML graphics provides the user with the most powerful and easy-to-use operator interface in the industry. The richness and flexibility of what can be achieved is unrivalled.

In addition to the ability to draw basic shapes like lines, polylines, curves, polygons, ellipses, arcs etc, the list of functions includes:

- Components and symbols. Use the symbols supplied with TGML, e.g. DIN and ISO, or create your own library with your preferred look and feel.
- Windows standard user interface 'drag and drop' can be used in the editor.
- Change object appearance with fill color, stroke color, width, height, font, font size etc, and add effects like color gradients or semi-transparency
- Bind to any signal in a Vista system, to any property of a graphical object, or bind several Vista signals to several properties for dynamic behavior.
- Embed pictures and photos.
- Automatically convert OGC graphics.
- Animations and conversions.
- Javascript for more advanced user interaction.

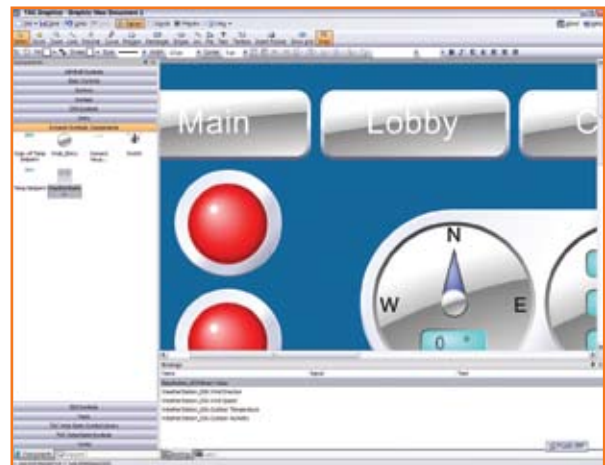

### DESCRIPTION

0-008-8222-0 New License

0-008-8322-0 Upgrade


0-008-8422-0 1 Year Maintenance Agreement

Maintenance Agreements - see page 10 for further details.

## TAC Vista 5 Database Generator

Software module for the efficient processing of project specific system data.

- Copying, editing and reusing existing system data from other projects
- Data import, export and conversion
- Conversion and adaptation of system information in the TAC Vista 5 database

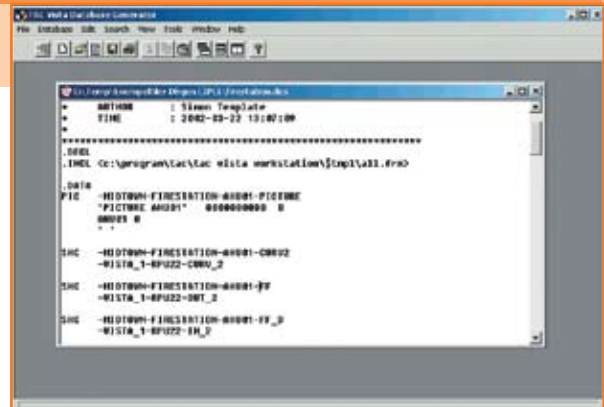

### DESCRIPTION

- 0-008-8227-0 New License
- 0-008-8327-0 Upgrade
- 0-008-8427-0 1 Year Maintenance Agreement

## TAC Vista 5 Communication System 7

Software module for communication with the TAC ZONE II and SYSTEM 7 systems. It supports PLB, KE11 and LCU-C communication interfaces and a dedicated/dial-up line connection is used for remote monitoring and/or remote control. Geographically remote systems can be connected via a modem. Automatic bi-directional dial-up (Auto Dial) is used for requests, changing values and for transferring alarms.

### DESCRIPTION

- 0-008-8252-0 New License
- 0-008-8352-0 Upgrade
- 0-008-8452-0 1 Year Maintenance Agreement

## TAC Vista 5 OPC Client

Software module for communicating with a wide range of third party drivers via an OPC server. Hundreds of examples of OPC servers are available for integrating devices and systems from other manufacturers. Drivers are available for the following communication protocols.

- ABB Master – Alfa Laval Automation – Andover – BACnet – BAS2800 – CAN – Carrier CCN – CSI
- Danfoss Danduc – EIB – Exomatic – Fabec/Tateco AB – FIX – Interbus-S – JCI – Landis & Gyr
- Modicon MODBUS – Panasonic – Profibus – Saia S-Bus – Toshiba – Telefrang N45 – TREND IQ70
- Siemens S7, H1, L2 – Siematic – York YT – Zerberus

Additional information and supply sources are available on request.

### DESCRIPTION

- 0-008-8251-0 New License
- 0-008-8351-0 Upgrade
- 0-008-8451-0 1 Year Maintenance Agreement

## TAC Vista OPC Server

A software module for open access, via an OPC standard interface, to the TAC Vista 5 server. Provides LONWORKS® network object data (nodes, network variables) as OPC objects in a continuously updated database and carries out all the packaging, converting and updating required for these objects.

- Client/server architecture
- Easy and convenient access to TAC Vista via OPC
- Automatic updating
- Suitable for large data quantities

### DESCRIPTION

0-008-7949-0 New License

---

## TAC Vista 5 CIPCL Editor

High-level language for efficient programming of special functions in the TAC Vista 5 Server.

- Programming language for logical and special functions in the server
- Source file preparation
- Program code conversion

### DESCRIPTION

0-008-8226-0 New License

0-008-8326-0 Upgrade

0-008-8426-0 1 Year Maintenance Agreement

---

## TAC Vista 5 IPCL Editor

High-level language for programming logical functions in TAC ZONE II and TAC SYSTEM 7 systems.

- Programming language for logical and special functions in the controller family TA 65XX and 67XX
- Source file preparation
- Download of software to the controllers

### DESCRIPTION

0-008-8225-0 New License

0-008-8325-0 Upgrade

0-008-8425-0 1 Year Maintenance Agreement

## TAC Vista 5 OPC Tool

Software module for the integration of OPC servers into the TAC Vista 5 database (clients). It is easy to operate and based on the Microsoft Windows standard. This minimizes the work required to configure the OPC client in the TAC Vista 5 server database. Structures and objects are imported into this from external OPC servers.


### DESCRIPTION

- 0-008-8224-0 New License
- 0-008-8324-0 Upgrade
- 0-008-8424-0 1 Year Maintenance Agreement

## TAC Vista 5 Webstation

The software module TAC Vista 5 Webstation gives access to TAC Vista 5 systems using a standard web browser via the Intranet /Internet. The following operating functions are supported:

- Display and acknowledge alarms
- Read and write values
- View graphics
- Trend logging
- Historical events
- Reports and charts

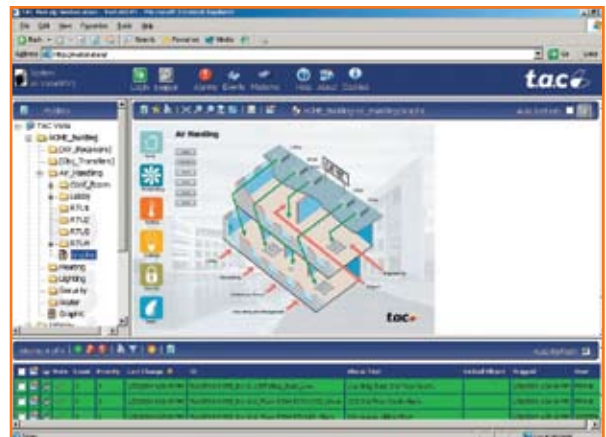

### DESCRIPTION

- |              |  |              |  |
|--------------|--|--------------|--|
| 0-008-8270-0 | New License – 1 User                   | 0-008-8472-0 | 1 Year Maintenance Agreement – 6 Users         |
| 0-008-8370-0 | Upgrade – 1 User                       | 0-008-8273-0 | New License – 12 Users                         |
| 0-008-8470-0 | 1 Year Maintenance Agreement – 1 User  | 0-008-8373-0 | Upgrade – 12 Users                             |
| 0-008-8271-0 | New License – 3 Users                  | 0-008-8473-0 | 1 Year Maintenance Agreement – 12 Users        |
| 0-008-8371-0 | Upgrade – 3 Users                      | 0-008-8274-0 | New License – Unlimited Users                  |
| 0-008-8471-0 | 1 Year Maintenance Agreement – 3 Users | 0-008-8374-0 | Upgrade – Unlimited Users                      |
| 0-008-8272-0 | New License – 6 Users                  | 0-008-8474-0 | 1 Year Maintenance Agreement – Unlimited Users |
| 0-008-8372-0 | Upgrade – 6 Users                      |              |  |

Maintenance Agreements - see page 10 for further details.

## TAC Vista ScreenMate (Virtual Room Unit)

Room control via the Intranet on a PC workstation.

- Virtual room control device as monitor image
- Individualized control configuration
- Variable setting of room functions such as:
  - Dimming lights
  - Switching lights
  - Adjusting blinds
  - Change setpoints
  - Display of actual values



- 0-008-8281-0 New License – 20 Users
- 0-008-8381-0 Upgrade – 20 Users
- 0-008-8481-0 1 Year Maintenance Agreement – 20 Users

### DESCRIPTION

- 0-008-8280-0 New License – 10 Users
- 0-008-8380-0 Upgrade – 10 Users
- 0-008-8480-0 1 Year Maintenance Agreement – 10 Users
- 0-008-8282-0 New License – 100 Users
- 0-008-8382-0 Upgrade – 100 Users
- 0-008-8482-0 1 Year Maintenance Agreement – 100 Users

## TAC Vista Host Tool

We have integrated TAC I/NET with TAC Vista. The result is a uniquely well structured and feature rich solution, enabling users to operate TAC Vista/TAC Xenta and I/NET systems using one user interface.

If the advanced functions enabled by the I/NET Host Tool are required by end customers, TAC I/NET Security or TAC I/NET Integrated licenses are required. TAC I/NET Security limits the Host Tool to presenting access control and security options only.

### DESCRIPTION – VISTA 5 I/NET INTEGRATED

- 0-008-8228-0 New License
- 0-008-8328-0 Upgrade
- 0-008-8428-0 1 Year Maintenance Agreement

### DESCRIPTION – VISTA 5 I/NET SECURITY

- 0-008-8229-0 New License
- 0-008-8329-0 Upgrade
- 0-008-8429-0 1 Year Maintenance Agreement

## LNS® Server

The Echelon® LNS Server is used to expand the TAC Vista 5 Server so that it can communicate with LonWORKS® devices directly via LNS. The LNS Server is required for systems where LonMaker® is not installed.

### DESCRIPTION

- 0-008-8253-0 Vista 5 LNS Server
- 0-008-8353-0 Vista 5 LNS Server Upg
- 0-008-8453-0 1 year Vista LNS Server

Maintenance Agreements - see page 10 for further details.



## Vista FM

TAC Vista FM is a suite of software solutions, built around an integrated database, that gives you a window into the cost and performance of your buildings. It collects and reports – in clear, readable presentations and charts – the information needed to manage operational, system and technical data throughout the building lifecycle.

Fully integrated with the TAC Vista building automation system, Vista FM draws on real time information so you accurately see the big picture, or drill down for details to:

- Track budgets across organizations and buildings
- Respond to and manage service calls
- View and manage energy consumption
- Handle work orders for suppliers and contractors
- Analyze trends and set targets
- Develop strategic plans for optimum building performance and cost

### VISTA FM MAINTENANCE

- Maintenance schedules
- Maintenance history
- Maintenance instructions
- Resource management
- Weekly work orders
- Reactive maintenance
- Progress monitoring

### VISTA FM HELPDESK


- Requests
- Work orders
- Contacts
- Resource management
- Monitoring
- Fault history
- Feedback

### VISTA FM LONG TERM PLANNING (LTP)

- Action planning and scheduling
- Cost estimates
- Repair history
- Survey reports

### VISTA FM CONTRACT

- Flexible structure of contracts
- Check dates and other detail controls
- Search and reporting
- Contract parties and contract costs

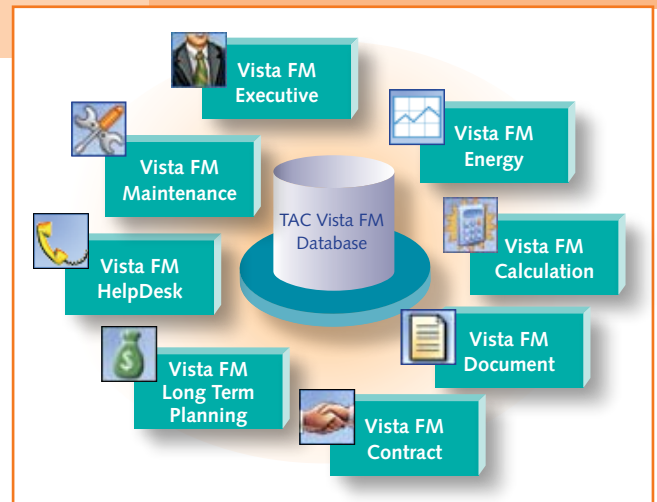

### VISTA FM EXECUTIVE

- Long-term planning
- Strategic decision making
- High-level view of maintenance, energy, etc.
- Links to Vista FM database

### VISTA FM ENERGY

- Environmental impact of energy use
- Reading interval adjustment
- Degree-days
- Main and sub meters
- Meter changes
- Versatile reporting
- Meter reading schedules
- Freely definable monitoring objects
- Direct link to building automation system

### VISTA FM CALCULATION

- Air handling unit energy consumption
- Can download real time data from the Vista building automation system
- Temperature set points, time schedules, etc.
- Effect of tariffs

### VISTA FM DOCUMENT

- CAD drawings
- Word and Excel files
- Digital photographs
- Links to Vista FM database
- File borrowing information
- Search capabilities
- Archiving

# Engineering Tools

## Vista FM (continued)

### NEW LICENSE

|              |                               |
|--------------|-------------------------------|
| 0-008-8080-0 | TAC Vista FM Base             |
| 0-008-8081-0 | TAC Vista FM Maintenance      |
| 0-008-8082-0 | TAC Vista FM HelpDesk         |
| 0-008-8083-0 | TAC Vista FM Document         |
| 0-008-8084-0 | TAC Vista FM Calculation      |
| 0-008-8085-0 | TAC Vista FM Energy           |
| 0-008-8086-0 | TAC Vista FM LTP              |
| 0-008-8087-0 | TAC Vista FM Contract         |
| 0-008-8088-0 | TAC Vista FM Signature        |
| 0-008-8089-0 | TAC Vista FM Executive        |
| 0-008-8100-0 | TAC Vista FM Web Base         |
| 0-008-8101-0 | TAC Vista FM Web Maintenance  |
| 0-008-8102-0 | TAC Vista FM Web HelpDesk     |
| 0-008-8103-0 | TAC Vista FM Web HelpDesk Req |
| 0-008-8104-0 | TAC Vista FM Web Document     |
| 0-008-8105-0 | TAC Vista FM Web Energy       |
| 0-008-8106-0 | TAC Vista FM Web LTP          |
| 0-008-8107-0 | TAC Vista FM Web MaintBook    |
| 0-008-8108-0 | TAC Vista FM Web Executive    |


### MAINTENANCE AGREEMENT

|              |                                      |
|--------------|--------------------------------------|
| 0-008-8120-0 | 1 year TAC Vista FM Base             |
| 0-008-8121-0 | 1 year TAC Vista FM Maintenance      |
| 0-008-8122-0 | 1 year TAC Vista FM HelpDesk         |
| 0-008-8123-0 | 1 year TAC Vista FM Document         |
| 0-008-8124-0 | 1 year TAC Vista FM Calculation      |
| 0-008-8125-0 | 1 year TAC Vista FM Energy           |
| 0-008-8126-0 | 1 year TAC Vista FM LTP              |
| 0-008-8127-0 | 1 year TAC Vista FM Contract         |
| 0-008-8128-0 | 1 year TAC Vista FM Signature        |
| 0-008-8129-0 | 1 year TAC Vista FM Executive        |
| 0-008-8140-0 | 1 year TAC Vista FM Web Base         |
| 0-008-8141-0 | 1 year TAC Vista FM Web Maintenance  |
| 0-008-8142-0 | 1 year TAC Vista FM Web HelpDesk     |
| 0-008-8143-0 | 1 year TAC Vista FM Web HelpDesk Req |
| 0-008-8144-0 | 1 year TAC Vista FM Web Document     |
| 0-008-8145-0 | 1 year TAC Vista FM Web Energy       |
| 0-008-8146-0 | 1 year TAC Vista FM Web LTP          |
| 0-008-8147-0 | 1 year TAC Vista FM Web MaintBook    |
| 0-008-8148-0 | 1 year TAC Vista FM Web Executive    |

## TAC Menta®

Fully featured, graphical engineering tool for programming, commissioning and operating TAC Xenta® controllers.

- Easy graphical programming
- Wide range of functions and application libraries
- Trend logging, scheduling and alarm definitions
- Automatic creation of LONWORKS® object files in XIF format
- Offline simulation
- Single step execution
- Online operating functions
- Dynamic online trend
- Documentation support
- Downloading of software to TAC Xenta controllers
- Fully integrated with the TAC Vista database
- Definition of the menu structure for the TAC Xenta OP, Operator Panel

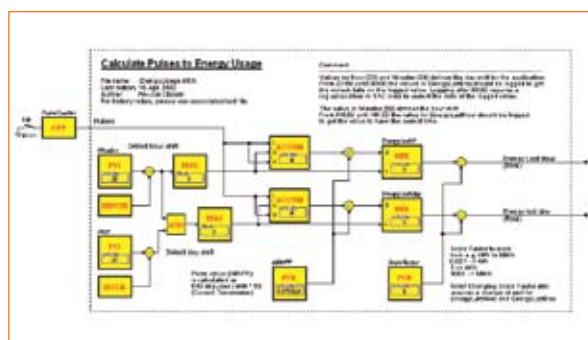

### DESCRIPTION

- 0-008-8240-0 New License
- 0-008-8340-0 Upgrade
- 0-008-8440-0 1 Year Maintenance Agreement

Maintenance Agreements - see page 10 for further details.




## TAC XBuilder

TAC XBuilder is the programming tool for TAC Xenta 511, (version 2.0 and later). XBuilder addresses the programming task from the end user point of view, instead of from the device point of view. XBuilder is a project oriented tool, which means all data in an application will be stored in a project container.

The user interface is intuitive and customizable with four main windows.

- System – describes the logical system with objects and connections
- Network – describes the physical implementation of the system with objects
- Properties – describes the properties of the selected object in the System or Network window
- Output – informs the user about errors and warnings in the project

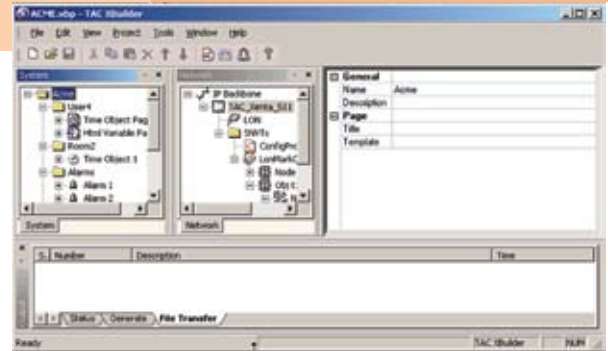

### DESCRIPTION

0-008-8241-0 New License

0-008-8341-0 Upgrade

0-008-8441-0 1 Year Maintenance Agreement


## TAC Vista OPC Tool

The TAC Vista OPC Tool is a tool used for browsing OPC servers and automatically programming the TAC Vista database. Specifically, this tool is used for TAC OPC server for Danduc, I/Net OPC server or any other OPC server supporting OPC Data Access, alarm & events or historical data.

Programming the TAC Vista database involves choosing the signals and trend logs you need to generate and operate. After generation of the objects, TAC Vista will be able to communicate with any equipment that is handled by an OPC server.

TAC Vista OPC Tool can be used to perform these tasks:

- Locate OPC servers locally or on any node of a network
- Browse the hierarchy of items in the OPC server
- Create and update objects for the TAC Vista database
- Substitute unsupported characters in OPC servers
- Log result to a log file

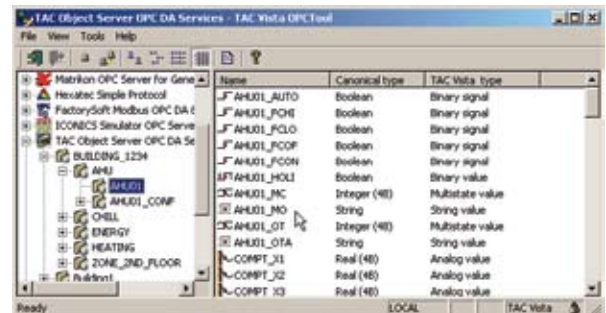

### DESCRIPTION

0-008-8224-0 New License


0-008-8324-0 Upgrade

0-008-8424-0 1 Year Maintenance Agreement

## LonMaker® Network Management Tool

High performance network management tool for creating, installing and maintaining multi-vendor, open and interoperable LonWorks® networks. The LonMaker® Management Tool is based on Echelon's LNS® network operating system, and combines high performance client-server architecture with the user-friendly Microsoft® Visio® user interface.

- Simple graphics programming
- Based on LNS operating system and Microsoft Visio
- Supports remote access via LonWorks® or IP networks
- Connection of independent networks to one network
- Simple installation of LonMark® applications
- Supports Plug-ins for TAC Xenta 100 series zone controllers
- Supports simultaneous access by several users

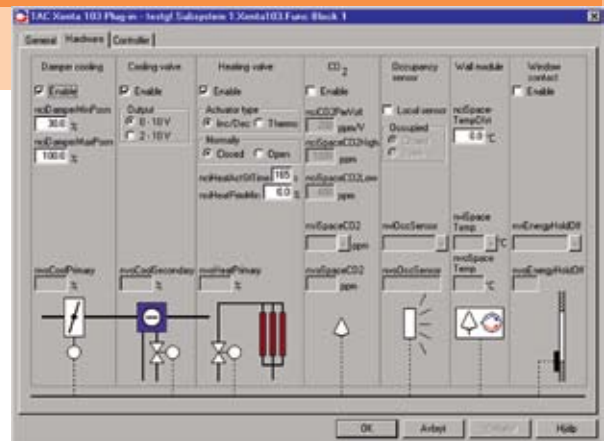

### DESCRIPTION

- 9-008-0003-0 Credits for LonMaker® Network Management Tool (100 units)
- 9-008-0013-0 LonMaker® 3.2 Standard Edition
- 9-008-0014-0 LonMaker® 3.2 Professional Edition
- 9-008-0015-0 LonMaker® 3.2 Standard Edition Upgrade
- 9-008-0016-0 LonMaker® 3.2 Pro Edition Upgrade



# Hardware





# TAC Xenta

## Ethernet Devices

The convergence of Internet and LonWorks® technology creates new opportunities in building automation, and TAC is in the forefront of this development with the concept of Open Systems for Building IT.

TAC provides a number of Ethernet devices to let you save a large portion of the infrastructure cost for systems installation by sharing already installed network cables.

The table below provides an overview of the TAC Xenta range of Ethernet devices and their functionality.

| Product                    | Function             |                  |              |              |           |        |           |         |          |             |                               |
|----------------------------|----------------------|------------------|--------------|--------------|-----------|--------|-----------|---------|----------|-------------|-------------------------------|
|                            | Web                  | LTA <sup>1</sup> | Xenta Server | I/NET Points | I/NET NPR | Modbus | Protocols | Gateway | MicroNet | I/O Modules | Support for Xenta 280/300/401 |
| TAC Xenta 511              | ▼                    | ▼                | ▼            |              |           |        |           | ▼       |          |             | ▼                             |
| TAC Xenta 511-B            | ▼                    | ▼                | ▼            |              |           | ▼      |           | ▼       |          |             | ▼                             |
| TAC Xenta 527              | ▼                    |                  | ▼            | ▼            | ▼         |        |           | ▼       |          |             |                               |
| TAC Xenta 527-NPR          |                      |                  |              | ▼            | ▼         |        |           |         |          |             |                               |
| TAC Xenta 701              | Service <sup>3</sup> | ▼                | ▼            |              |           |        |           |         |          | 10          |                               |
| TAC Xenta 711              | Custom <sup>4</sup>  | ▼                | ▼            |              |           |        |           |         |          | 10          | ▼                             |
| TAC Xenta 721              | Service <sup>3</sup> | ▼                | ▼            |              |           |        |           |         |          | 20          | ▼                             |
| TAC Xenta 731              | Custom <sup>4</sup>  | ▼                | ▼            | ▼            | ▼         | ▼      |           |         | ▼        | 20          | ▼                             |
| TAC Xenta 913              |                      | ▼                | ▼            | ▼            |           | ▼      | ▼         | ▼       |          |             |                               |
| TAC Xenta 911 <sup>2</sup> |                      | ▼                |              |              |           |        |           |         |          |             |                               |

1 - LonTalk Adapter

2 - Xenta 911 also supports IP Modem and Remote Serial Port

3 - Web pages automatically generated for commissioning and service purposes only. No end-user web content available.

4 - Totally configurable end-user web pages available





## TAC Xenta® 511/511-B Web Server

The TAC Xenta 511 is a web-based presentation system for LONWORKS® and MODBUS networks. Using a standard web browser, the operator can easily view and control the devices in the LONWORKS® network via the Internet or a local intranet. One TAC Xenta 511 can present a small to medium LONWORKS® network or be one of several local presentation devices in a larger network.

The TAC Xenta 511 can also be used as an LTA (LonTalk® adapter) between TAC Vista and the LONWORKS® network.

### FUNCTIONAL FEATURES

- Multiple access levels
- Security functions for TCP/IP firewalls
- Complete alarm handling
- Alarm routines for sending e-mails that can be converted to SMS and reports
- Dynamic color graphics (automatic updating)
- Display of values in diagrams
- Data logging and data logging viewer
- Ability to change values/conditions (e.g. setpoints)
- Ready-made menus, help functions and links to web pages
- Storage of customer-specific documentation and web pages

Supports SNVT (Standard Network Variable Types) in accordance with LonMark® and TAC network variables. Changes are immediately visible to all users. TAC XBuilder is used to create web pages, and for the installation and initial operation of the TAC Xenta 511.

### SPECIFICATIONS

Supply voltage . . . . . 24 V AC ±20%, 19 - 40 V DC

Power consumption . . . . . max. 5 W

Transformer sizing . . . . . 5 VA

#### Ambient Temperature

Storage. . . . . -20 °C to +50 °C  
(-4 °F to +122 °F)

Operation. . . . . 0 °C to +50 °C  
(+32 °F to +122 °F)

Humidity . . . . . max. 90% RH non-condensing

#### Real Time Clock

Accuracy at +25 °C (77°F) . . . . . ±12 minutes per year

Data backup in event of power failure . . 72 h

Dimensions incl. base . . . . . 90 x 110 x 77mm  
(3.5"x4.3"x3.0")

Enclosure rating . . . . . IP 20

#### Communication

Modem . . . . . 2400 - 57600 bps, RS232A, RJ45,  
8-p

PC configuration . . . . . RS232B, RJ10, 4-p

LonWorks® . . . . . FTT-10, screw terminal

MODBUS . . . . . RS 485 (TAC Xenta 511-B)

Ethernet . . . . . TCP/IP, 10Base-T, RJ45

#### Memory

Internal memory. . . . . 16 MB

External memory . . . . . expandable with MMC  
(4 - 128 MB, MMC card)

For further specifications, see technical data sheet.

### DESCRIPTION

0-073-0811-0 TAC Xenta 511

0-073-0812-0 TAC Xenta 511-B

### ACCESSORIES

0-073-0902-0 Terminal part for all Xenta 4/5/9xx

0-073-0920-0 TAC Xenta: Programming Serial Kit for all Xenta 4/5/9xx



## TAC Xenta 527

The TAC Xenta 527 is a comprehensive presentation system, which enables secure web access to both TAC I/NET Seven and TAC Vista™ networks simultaneously. It provides you with the freedom to monitor your system from any location with Internet access. With automatic network discovery of TAC I/NET systems, the only configuration needed is to point the Xenta 527 to TAC I/NET's NetPlus™ Routers or TAC I/NET Hosts. After that, your entire TAC I/NET network is immediately available through the web interface.

You can access any point in your system, either through the convenient browse functionality, or via a graphic page link. Comprehensive control features include changing values such as set points, optimization parameters, and PID parameters. Manual control features such as test, hold, and manual are all supported as well as acknowledge, and momentary release for doors.

### FUNCTIONAL FEATURES

- Real time graphics and dynamic data
- Simultaneous presentation of TAC I/NET and TAC Vista systems
- Trend logging and analysis
- Time scheduling
- Time synchronization
- Alarm management
- Alarm notification via email
- Device mode management
- Event viewing and filtering
- Point control
- Operator security
- Personal home page
- Wireless Sensor Support
- Embedded Net Plus router
- Peer to Peer linking of TAC I/NET to LON® signals
- Configurable Encryption for TAC I/NET I/P communications
- Supports DNS and DHCP configurations
- Comprehensive SNMP integration
- On-board Controller LAN connection

### SPECIFICATIONS

Dimensions . . . . . 90 x 110 x 77mm (3.5" x 4.3" x 3.0")  
 Supply voltage . . . . . 24 V AC ±20%, 50/60 Hz or 19–40 V DC  
 Power consumption . . . . . max. 5 W  
 Transformer sizing . . . . . .5 VA

#### Ambient Temperature

Storage . . . . . –20 °C to +50 °C (–4 °F to +122 °F)  
 Operation . . . . . 0 °C to +50 °C (+32 °F to +122 °F)  
 Humidity . . . . . max. 90% RH non-condensing

#### Mechanical

Dimensions . . . . . 90 x 110 x 77mm (3.5" x 4.3" x 3")  
 Weight . . . . . 0.2 kg (0.44 lb.)  
 Enclosure rating . . . . . IP 20

#### Real Time Clock

Accuracy at +25 °C (77°F) . . . . ±12 minutes per year  
 Power failure protection . . . . .72 h

#### Communication

A: RS232 . . . . . 2400 – 57600 bps, RJ45, 8-p  
 A: RS485 . . . . . 2400 – 57600 bps, async. terminal block  
 B: RS232 . . . . . RJ10, 4-p  
 C: RS485 . . . . . sync. (SDLC) terminal block  
 LONWORKS® . . . . . TP/FT-10, terminal block  
 Ethernet . . . . . TCP/IP, 10Base-T, RJ45

#### Memory

Internal memory . . . . . 16 MB  
 External memory . . . . . expandable with MMC  
 (4 – 128 MB, MMC card)

### DESCRIPTION

0-073-0820-0 TAC Xenta 527

### ACCESSORIES

0-073-0902-0 Terminal part TAC Xenta 400

0-073-0920-0 TAC Xenta: Programming Serial Kit



## TAC Xenta 913 LONWORKS® Gateway

The TAC Xenta 913 is a cost-effective way to integrate a large variety of products into a TAC network. The TAC Xenta 913 supports the most commonly used open protocols, such as MODBUS, BACnet and LONWORKS®. It also supports some manufacturer-specific protocols, e.g. I/NET and Clipsal C-bus.

The TAC Xenta 913 acts as a gateway, and transfers data point values from one network to another. Configuration is carried out using the TAC XBuilder programming tool.

### FUNCTIONAL FEATURES

- Freedom to migrate to open systems
- Bridges the gap between two protocols and communication technologies
- Handles most common protocols
- Easy to operate
- Reliable and cost effective
- Links chiller plants
- Integrates power meters

| Protocol         | Description/<br>Model             | Driver Description  |
|------------------|-----------------------------------|---|
| BACnet           | BACnet IP /<br>MS-TP / PTP        | BACnet is a standard protocol for building automation developed by ASHRAE. Supports BACnet ReadProperty and WriteProperty messages.<br>Max. no. of devices: IP: 10, MS-TP: 30, PTP: 10  |
| MODBUS/<br>J-Bus | MODBUS<br>Master / Slave<br>/ TCP | Commonly used protocol by many PLCs and other equipment manufacturers. <ul style="list-style-type: none"> <li>• Uses Poll-on-demand to extract data</li> <li>• RTU or ASCII Formats</li> <li>• Supports 01, 02, 03, 04, 05, 06 and 10 MODBUS functions</li> </ul> Max. no. of devices: As Master: 31 Slaves, As Slave: 1 Master, TCP: 100 |
| M-Bus            | Metering Bus                      | M-Bus is a standard protocol for meters. Requires a hardware converter between RS-232 and M-Bus e.g. Level-Converter PW20 from Relay GmbH.<br>Max. no. of devices: 200  |
| C-Bus            | Clipsal bus                       | C-Bus is a proprietary communication protocol of Clipsal Lighting Control Systems.<br>Max. no. of devices: 50   |
| LONWORKS®        | FT-10                             | LONWORKS® is a standard communication, extensively used in building automation. Up to 400 SNVTs or TAC Xenta network variables.   |
| I/NET            | Host LAN /<br>Controller LAN      | I/NET is a proprietary protocol for I/NET systems from TAC.   |

## TAC Xenta 913 LONWORKS® Gateway (continued)

### SPECIFICATIONS

Operating voltage . . . . .24 V AC  $\pm$ 20%, 50/60 Hz or 19–40 V DC  
Power consumption . . . . .max 5 W  
Transformer sizing . . . . .5 VA  
Dimensions. . . . .90 x 110 x 77mm (3.5" x 4.3" x 3")  
Enclosure rating . . . . .IP 20

#### Real Time Clock

Accuracy at +25°C (77° F) . . . . . $\pm$ 12 minutes per year  
Power failure protection. . . . .72 h

#### Ambient Temperature

Storage. . . . .–20°C to +50°C (–4°F to +122°F)  
Operation. . . . .0°C to +50°C (+32°F to +122°F)  
Humidity . . . . .max. 90% RH non-condensing

#### Communication

A: RS232 . . . . .2400 – 57600 bps, RJ45, 8-p  
A: RS485 . . . . .2400 – 57600 bps, async. terminal block  
B: RS232 . . . . .RJ10, 4-p  
C: RS485 . . . . .sync. (SDLC) terminal block  
LONWORKS®. . . . .TP/FT-10, terminal block  
Ethernet . . . . .TCP/IP, 10Base-T, RJ45

---

### DESCRIPTION

0-073-0835-1 TAC Xenta 913

---

### ACCESSORIES

0-073-0902-0 Terminal part TAC Xenta 400

0-073-0920-0 TAC Xenta: Programming Serial Kit



## FUNCTIONAL FEATURES

- Works as a LonTalk® adapter over IP between TAC Vista and a LONWORKS® network
- Supports TAC Xenta controllers and most TAC legacy products
- Configurable over an IP network with a standard web browser
- Pre-configured for most TAC products
- Real time clock
- All configuration data, e.g. like telephone numbers, are stored in a non-volatile memory

Supports SNVT (Standard Network Variable Types) in accordance with LONMARK® and TAC network variables.

## TAC Xenta 911

The TAC Xenta 911 communication device can be configured in three different ways:

- As a LonTalk® adapter between TAC Vista and a LONWORKS® network
- As an IP modem, working as a direct replacement for a telephone modem, with dial-up functionality over the computer network
- As a remote serial port, meaning the serial port of Xenta 911 can be used as if it was a serial port on the PC. To be used for the serial protocols of Vista.

In the latter case, TAC Xenta 911 is intended for use with most TAC units supporting dial-up. See the data sheet for TAC Xenta 911. The IP address of the "dialed-up" unit will then replace the telephone number. This makes it very easy to save money by eliminating telephone line costs. The fast dial-up time, typically less than two seconds, provides the feeling of a directly connected network.

The TAC Xenta 911 is quick to install and is easily maintained, using a web browser on the TCP/IP network. Its default values are set for TAC Xenta connection, and it is pre-configured for most TAC products.

The TAC Xenta 911 contains HTML pages providing comprehensive on-line help.

## SPECIFICATIONS

|                                       |   |
|---------------------------------------|---|
| Supply voltage                        | . . . . . 24 V AC ±20%, 50 / 60 Hz or<br>19-40 V DC       |
| Power consumption                     | . . . . . max. 5 W  |
| Ambient Temperature                   |   |
| Storage                               | . . . . . -20 °C to +50 °C<br>(-4 °F to +122 °F)          |
| Operation                             | . . . . . 0 °C to +50 °C<br>(+32 °F to +122 °F)           |
| Humidity                              | . . . . . max. 90% RH non-condensing                      |
| Real Time Clock                       |   |
| Accuracy at 25 °C (77°F)              | . . . . . ±12 minutes per year                            |
| Data backup in event of power failure | . . . 72 h  |
| Mechanical                            |   |
| Dimensions incl. base                 | . . . . . 90 x 110 x 77mm<br>(3.5" x 4.3" x 3")           |
| Enclosure rating                      | . . . . . IP 20   |
| Communication                         |   |
| Modem                                 | . . . . . 2400 - 57600 bps, RS232A, RJ45,<br>8-p (port A) |
| PC configuration                      | . . . . . RS232A, RJ45, 4-p (port B)                      |
| Network                               | . . . . . LONWORKS®, FTT-10, screw terminal               |
| Ethernet                              | . . . . . TCP/IP, 10base-T, RJ45                          |

## DESCRIPTION

0-073-0831-0 TAC Xenta 911

## ACCESSORIES

0-073-0902-0 Terminal part TAC Xenta 400

0-073-0920-0 TAC Xenta: Programming Serial Kit



## TAC Xenta 700 Controller

The TAC Xenta 700 series is a multifunctional presentation and control system with an embedded web server that allows you to access your control application and control networks via a web browser - anywhere in the world, at any time. TAC Xenta 700 series controllers are the first to combine building automation, web functionality, alarm handling and amazing graphics, all in a powerful, compact package. This all-in-one solution has everything you need to monitor and control your settings in a single economical device. Furthermore, Xenta 700 controllers are Xenta servers designed to be connected via TCP/IP to TAC Vista in larger installations, aggregating data for easy operation and benchmarking.

All functions for daily operations such as Alarm Handling, Trend Logging and Viewing, Event Handling, Time Schedules, Advanced Dynamic Graphics, are included. The TAC Xenta 700 series comprises four controllers, as per the table below.

### FUNCTIONAL FEATURES

- TAC Xenta 700 controller family with built-in web functionality
- Configurable or automatically generated Web interface
- Complete web-based Building Management System
- Highly scalable systems based on TAC Xenta 700 in combination with TAC Vista
- IP connectivity enabling worldwide access via the Internet
- Versatile and easily learnt TAC Menta programming tool
- Several TAC Menta applications can run simultaneously
- Multiple instances of one TAC Menta application for easy engineering
- High performance control applications
- Efficient engineering based on the TAC XBuilder tool
- Security functions for TCP/IP firewalls
- Complete alarm handling capability
- Dynamic color graphics (updated automatically)
- Flexible value displays - in diagrammatic or tabular form
- Data logging and data logging viewer

| Supports  | Modbus | MicroNet | I/NET | Web     | I/O Modules | Xenta 280/300/401 |
|-----------|--------|----------|-------|---------|-------------|-------------------|
| Xenta 701 |        |          |       | Service | 10          |                   |
| XENTA 711 |        |          |       | Custom  | 10          | ▼                 |
| Xenta 721 |        |          |       | Service | 20          | ▼                 |
| Xenta 731 | ▼      | ▼        | ▼     | Custom  | 20          | ▼                 |

Service - web pages generated automatically for commissioning and service purposes only. No end-user web content available.

Custom - totally configurable end-user web pages available.

### SPECIFICATIONS

Operating voltage . . . . . 24 V AC  $\pm$ 20%, 50/60 Hz or 19–40 V DC  
 Power consumption . . . . . max 5 W  
 Transformer sizing . . . . . 5 VA  
 Dimensions. . . . . 90 x 110 x 77mm (3.5" x 4.3" x 3")  
 Enclosure rating . . . . . IP 20

#### Real Time Clock

Accuracy at +25°C (77° F) . . . . .  $\pm$ 12 minutes per year  
 Power failure protection. . . . . 72 h

#### Ambient Temperature

Storage. . . . . –20°C to +50°C (–4°F to +122°F)  
 Operation. . . . . 0°C to +50°C (+32°F to +122°F)  
 Humidity . . . . . max. 90% RH non-condensing

#### Communication

A: RS232 . . . . . 2400 – 57600 bps, RJ45, 8-p  
 A: RS485 . . . . . 2400 – 57600 bps, async. terminal block  
 B: RS232 . . . . . RJ10, 4-p  
 C: RS485 (Xenta 731) . . . . . sync. (SDLC) terminal block  
 LONWORKS® . . . . . TP/FT-10, terminal block  
 Ethernet . . . . . TCP/IP, 10Base-T, RJ45

### DESCRIPTION

|              |                       |                                       |
|--------------|-----------------------|---------------------------------------|
| 0-073-0150-0 | El.Part TAC Xenta 701 | TCP/IP based controller               |
| 0-073-0155-0 | El.Part TAC Xenta 711 | TCP/IP based controller, end-user web |
| 0-073-0160-0 | El.Part TAC Xenta 721 | TCP/IP based controller               |
| 0-073-0165-0 | El.Part TAC Xenta 731 | TCP/IP based controller, end-user web |

### ACCESSORIES

- 0-073-0902 Terminal part TAC Xenta 400.
- 0-073-0920 TAC Xenta: Programming Serial Kit

# Programmable Controllers





# TAC Xenta

## Programmable Controllers

TAC Xenta is a range of LonMark®-certified programmable controllers intended for control of small, medium and large heating, ventilation and air-conditioning systems. TAC Xenta series controllers are designed for use in open systems and for integration via LonWorks® – an industrial standard for network communications which enables a range of different systems within a property, such as HVAC, lighting and access control, to be integrated on the same network. TAC Xenta series provides an open, future-proof system architecture. At the same time, it provides access to standardized network technology supporting a flexible control system, to which components from other manufacturers can be connected.

### DESIGNED FOR EFFECTIVE CONTROL OF HEATING AND VENTILATION

The TAC Xenta programmable controllers have full HVAC functionality, including control loops, control curves, time control, alarm handling, etc.

### SIMPLICITY OF INSTALLATION

The controllers are freely programmable and can be fitted in a standard enclosure or a control panel. Installation is extremely simple. The controller is designed for installation adjacent to the equipment that it controls, which greatly simplifies wiring. The unique TAC Menta graphic programming tool quickly adapts the controller for different types of control and/or supervisory applications. Engineering is further simplified by the fact that TAC Menta contains a large number of pre-programmed function blocks, together with a comprehensive library of functions.

### DEVELOPED FOR NETWORK COMMUNICATION

The TAC Xenta can be used either independently or as a communicating controller in a larger system. Several controllers can be easily connected to form a network and exchange data. In addition, the TAC Xenta series controller can be connected to TAC Vista – a Building Management System running under Windows® for controlling and analyzing all aspects of performance, either in individual buildings or a whole area.



# TAC Xenta Programmable Controllers Overview

|                           | Controllers         |           |           |                           |           |                     | I/O modules   |                 |                 |           |               |
|---------------------------|---------------------|-----------|-----------|---------------------------|-----------|---------------------|---------------|-----------------|-----------------|-----------|---------------|
| Device                    | Xenta 281           | Xenta 282 | Xenta 283 | Xenta 301                 | Xenta 302 | Xenta 401           | Xenta 411/412 | Xenta 421A/422A | Xenta 451A/452A | Xenta 471 | Xenta 491/492 |
| Usage                     | Small installations |           |           | Medium size installations |           | Large installations | I/O extension |                 |                 |           |               |
| I/O points                | 12                  | 16        | 12        | 20                        | 20        |                     | 10            | 9               | 10              | 8         | 8             |
| Digital Inputs, DI        | 2                   | 2         | 2         | 4                         | 4         |                     | 10            | 4               |                 |           |               |
| Thermistor Inputs, TI     |                     | 2         | 4         | 4                         | 4         |                     |               |                 |                 |           |               |
| Universal Inputs, UI      | 4                   | 4         |           | 4                         | 4         |                     |               |                 | 8               |           |               |
| Analog Inputs, AI         |                     |           |           |                           |           |                     |               |                 |                 | 8         |               |
| Digital Outputs Relay, DO | 3                   | 4         |           | 6                         | 4         |                     |               | 5               |                 |           |               |
| Digital Outputs Triac, DO |                     |           | 6         |                           |           |                     |               |                 |                 |           |               |
| Analog Outputs, AO        | 3                   | 4         |           | 2                         | 4         |                     |               |                 | 2               |           | 8             |
| Number of I/O modules     |                     |           |           | 2                         | 2         | 10                  |               |                 |                 |           |               |
| LONWORKS® variables       |                     |           |           |                           |           |                     |               |                 |                 |           |               |
| Number of input SVNTs     | 15                  | 15        | 15        | 15                        | 15        | 125                 |               | Yes (1)         | Yes (1)         |           |               |
| Number of output SVNTs    | 30                  | 30        | 30        | 30                        | 30        | 125                 |               | Yes (1)         | Yes (1)         |           |               |

1. The I/O points and configuration of these modules can be accessed via SNVTs.

# Programmable Controllers



## TAC Xenta 280

A compact, freely programmable controller which is LONMARK® certified and has fixed inputs and outputs. The controller is available in three different versions:

- TAC Xenta 281 (12 physical inputs/outputs)
- TAC Xenta 282 (16 physical inputs/outputs)
- TAC Xenta 283 (12 physical inputs/outputs)

The controllers can be easily programmed using the graphical programming tool TAC Menta. The controllers can be used in a stand-alone system, where the TAC Xenta OP can be used for displaying and operating the controller. Controllers can alternatively be used in larger LONWORKS® networks.

### FUNCTIONAL FEATURES

- Optimized for maximum flexibility in HVAC control with on board inputs and outputs
- Fully programmable using the intuitive TAC Menta programming tool
- Intelligent start time calculation minimizing energy usage
- Designed for use in open systems and integration via LonWorks
- Available in a range of models to secure cost-efficiency for each application
- Designed to work with TAC Vista

### SPECIFICATIONS

Operating voltage . . . . . 24 V AC/DC ±20%, 50/60 Hz

Power consumption . . . . . max. 5 W

Data backup in event of power failure . . 72 h RAM-Backup

Ambient Temperature

Storage. . . . . -20 °C to +50 °C

(-4 °F to +122 °F)

Operation. . . . . 0 °C to +50 °C

(+32 °F to +122 °F)

Humidity . . . . . max. 90% RH non-condensing

Dimensions incl. base . . . . . 180 x 110 x 77mm

(7" x 4.3" x 3")

Protocol . . . . . FTT-10, LonTalk®

Transmission rate . . . . . 78 kbits/s

External LONWORKS® data points

Input variable . . . . . max. 15 SNVTs

Output variable . . . . . max. 30 SNVTs

Interfaces

Serial connection . . . . . RS232, RJ45

Operator panel. . . . . Modular jack, LonTalk® Protocol

| Unit          | DI | DO | UI | TI | AO |
|---------------|----|----|----|----|----|
| TAC Xenta 281 | 2  | 3  | 4  | -  | 3  |
| TAC Xenta 282 | 2  | 4  | 4  | 2  | 4  |
| TAC Xenta 283 | 2  | 6  | -  | 4  | -  |

### DESCRIPTION

0-073-0030-0 TAC Xenta 281

0-073-0031-0 TAC Xenta 282

0-073-0032-0 TAC Xenta 283

### ACCESSORIES

0-073-0901-0 Terminal part for all Xenta 280/300

0-073-0920-0 TAC Xenta: Programming Serial Kit

# Programmable Controllers



## TAC Xenta 300 Stand Alone

A compact, freely programmable controller which is LONMARK® certified and has 20 fixed inputs and outputs. The controller can be expanded to up to 40 inputs/outputs using two expansion modules. It does not include peer-to-peer or BMS (TAC Vista) communication. The controller can be upgraded at any time to a networkable version without changing the hardware. The TAC Xenta OP Operator Panel and a compatible terminal block are included in the stand-alone package.

### FUNCTIONAL FEATURES

- Optimized for maximum flexibility in HVAC control with on board inputs and outputs
- Fully programmable using the intuitive TAC Menta programming tool
- Intelligent start time calculation minimizing energy usage
- Available in a range of models to secure cost-efficiency for each application
- I/O points can be extended by TAC Xenta 400 I/O modules

### SPECIFICATIONS

Operating voltage . . . . . 24 V AC/DC ±20%, 50/60 Hz

Power consumption . . . . . max. 5 W

Data backup in event of power failure . . 72 h RAM-Backup

#### Ambient Temperature

Storage . . . . . -20 °C to +50 °C  
(-4 °F to +122 °F)

Operation . . . . . 0 °C to +50 °C  
(+32 °F to +122 °F)

#### Humidity . . . . .

Dimensions incl. base . . . . . 180 x 110 x 77mm  
(7" x 4.3" x 3")

Protocol . . . . . FTT-10, LonTalk®

Transmission rate . . . . . 78 kbits/s

#### External LONWORKS® data points

Input variable . . . . . max. 15 SNVTs

Output variable . . . . . max. 30 SNVTs

#### Interfaces

Serial connection . . . . . RS232, RJ45 for PC or modem  
(up to 9600 bit/s)

Operator panel . . . . . Modular jack, LonTalk® Protocol

For further specifications, see technical data sheet.

| Unit          | UI | DI | TI | AO | DO |
|---------------|----|----|----|----|----|
| TAC Xenta 301 | 4  | 4  | 4  | 2  | 6  |
| TAC Xenta 302 | 4  | 4  | 4  | 4  | 4  |

### DESCRIPTION

0-073-0088-2 TAC Xenta 301/OP Stand Alone

0-073-0089-2 TAC Xenta 302/OP Stand Alone

0-008-7298-1 Upgrade TAC Xenta 300V3 to N/P

### ACCESSORIES

0-073-0901-0 Terminal part TAC Xenta 280/300

0-073-0920-0 TAC Xenta: Programming Serial Kit

# Programmable Controllers



## TAC Xenta 300 Base Unit

A compact, networkable, freely programmable controller which is LONMARK® certified and has 20 fixed inputs and outputs. It can be expanded for up to 40 inputs/outputs using 2 expansion modules. Data can be directly accessed on site using a TAC Xenta OP Operator Panel.

### FUNCTIONAL FEATURES

- Optimized for maximum flexibility in HVAC control with on board inputs and outputs
- Fully programmable using the intuitive TAC Menta programming tool
- Intelligent start time calculation minimizing energy usage
- Designed for use in open systems and integration via LonWorks
- Available in a range of models to secure cost-efficiency for each application
- I/O points can be extended by TAC Xenta 400 I/O modules
- Designed to work with TAC Vista

### SPECIFICATIONS

Operating voltage . . . . . 24 V AC/DC  $\pm 20\%$ , 50/60 Hz  
 Power consumption . . . . . max. 5 W  
 Data backup in event of power failure . . . 72 h RAM-Backup

#### Ambient Temperature

Storage. . . . .  $-20\text{ }^{\circ}\text{C}$  to  $+50\text{ }^{\circ}\text{C}$   
 ( $-4\text{ }^{\circ}\text{F}$  to  $+122\text{ }^{\circ}\text{F}$ )

Operation. . . . .  $0\text{ }^{\circ}\text{C}$  to  $+50\text{ }^{\circ}\text{C}$   
 ( $+32\text{ }^{\circ}\text{F}$  to  $+122\text{ }^{\circ}\text{F}$ )

Humidity . . . . . max. 90% RH non-condensing

Dimensions incl. base . . . . . 180 x 110 x 77mm  
 (7" x 4.3" x 3")

Protocol . . . . . FTT-10, LonTalk®

Transmission rate . . . . . 78 kbits/s

#### External LONWORKS® data points

Input variable . . . . . max. 15 SNVTs

Output variable . . . . . max. 30 SNVTs

#### Interfaces

Serial connection . . . . . RS232, RJ45 for PC or modem  
 (up to 9600 bit/s)

Operator panel. . . . . Modular jack, LonTalk® Protocol

For further specifications, see technical data sheet.

| Unit          | DI | DO | UI | TI | AO |
|---------------|----|----|----|----|----|
| TAC Xenta 301 | 4  | 6  | 4  | 4  | 2  |
| TAC Xenta 302 | 4  | 4  | 4  | 4  | 4  |

### DESCRIPTION

0-073-0009-2 TAC Xenta 301/N/P network- and PC-communication

0-073-0011-2 TAC Xenta 302/N/P network- and PC-communication

### ACCESSORIES

0-073-0901-0 Terminal part TAC Xenta 280/300

0-073-0907-2 Operator terminal TAC Xenta OP

0-073-0920-0 TAC Xenta: Programming Serial Kit

# Programmable Controllers



## TAC Xenta 401 and 401:B Base Unit

High performance, freely programmable, high end controller without its own physical inputs and outputs. LONMARK® certified. It can be expanded for up to 100 inputs/outputs with 10 expansion modules. It has a large memory so that the controller can be easily used for higher level functions (e.g. centralized schedule management).

### FUNCTIONAL FEATURES

- Powerful platform supporting complex applications
- Fully programmable using the intuitive TAC Menta programming tool
- Expandable I/O provides cost-effective solution
- Smart and powerful data logging maximizing storage capacity
- Extensive memory supporting trending and scheduling
- LONMARK®-certified enabling seamless integration with other building systems and functions

### SPECIFICATIONS

|                                       |  |
|---------------------------------------|--|
| Operating voltage                     | 24 V AC/DC ±20%, 50/60 Hz                      |
| Power consumption                     | max. 5 W                                       |
| Data backup in event of power failure | 72 h RAM Backup                                |
| Ambient Temperature                   |  |
| Storage                               | -20 °C to +50 °C (-4 °F to +122 °F)            |
| Operation                             | 0 °C to +50 °C (+32 °F to +122 °F)             |
| Humidity                              | max. 90% RH non-condensing                     |
| Dimensions incl. base                 |  |
|                                       | 90 x 110 x 77mm<br>(3.5" x 4.3" x 3")          |
| Protocol                              | FTT-10, LonTalk®                               |
| Transmission rate                     | 78 kbits/s                                     |
| External LONWORKS® data points        |  |
| TAC Xenta 401                         |  |
| Input variables                       | max. 125 SNVTs                                 |
| Output variables                      | max. 125 SNVTs                                 |
| TAC Xenta 401:B                       |  |
| Input variables                       | max. 210 SNVT                                  |
| Output variables                      | max. 70 SNVT                                   |
| Total number inputs and outputs       | max. 250 SNVT                                  |
| I/O modules                           |  |
| TAC Xenta 401                         | Max. 10  |
| TAC Xenta 401:B                       | 0  |
| Interfaces                            |  |
| Serial connection                     | RS232, RJ45 for PC or modem (up to 9600 bit/s) |
| Operator panel                        | Modular jack, LonTalk® Protocol                |

For further specifications, see technical data sheet.

### DESCRIPTION

0-073-0101-2 TAC Xenta 401

0-073-0103-0 TAC Xenta 401:B

### ACCESSORIES

0-073-0902-0 Terminal part TAC Xenta 400

0-073-0907-2 Operator terminal TAC Xenta OP

0-073-0920-0 TAC Xenta: Programming Serial Kit

# Programmable Controllers



## TAC Xenta 411/412 Digital Input Module

For monitoring and counting digital, dry contact signals. The digital input module is only to be used in combination with the TAC Xenta 300/401 basic controllers. The module is available either with or without status LEDs. The terminal block is not part of the electronic unit and must be ordered separately.

### FUNCTIONAL FEATURES

- Universal inputs provide installation flexibility
- Designed for TAC Vista systems
- Perfect for distributed installations
- Manual override switches provide local bypass operation
- Cost-effective installation and maintenance using separate terminal base and plug-in electronic units
- Individually configurable using the TAC Menta programming tool

### SPECIFICATIONS

Operating voltage . . . . . 24 V AC  $\pm 20\%$ , 50/60 Hz

Power consumption . . . . . max. 2 W

#### Ambient Temperature

Storage. . . . .  $-20\text{ }^{\circ}\text{C}$  to  $+50\text{ }^{\circ}\text{C}$  ( $-4\text{ }^{\circ}\text{F}$  to  $+122\text{ }^{\circ}\text{F}$ )

Operation. . . . .  $0\text{ }^{\circ}\text{C}$  to  $+50\text{ }^{\circ}\text{C}$  ( $+32\text{ }^{\circ}\text{F}$  to  $+122\text{ }^{\circ}\text{F}$ )

Humidity . . . . . max. 90% RH non-condensing

Dimensions incl. base . . . . . 90 x 110 x 77mm (3.5" x 4.3" x 3")

Protocol . . . . . FTT-10, LonTalk<sup>®</sup>

Transmission rate . . . . . 78 kbits/s

#### Digital inputs

Quantity . . . . . 10

Duration of counting pulse. . . . . min. 20 ms

Display . . . . . Status LEDs, red or green adjustable via  
DIP switch (TAC Xenta 412)

For further specifications, see technical data sheet.

### DESCRIPTION

0-073-0201-1 TAC Xenta 411 without LEDs

0-073-0203-1 TAC Xenta 412 with LEDs

### ACCESSORIES

0-073-0902-0 TAC Xenta 400 terminal part

# Programmable Controllers



## TAC Xenta 421A and 422A Universal Input and Digital Output Module

TAC Xenta 421A and 422A are Universal Input/Digital Output modules in the TAC Xenta family. They can be used as normal Xenta I/O modules or as certified LONMARK® devices. Both modules have four universal inputs and five digital outputs. The universal inputs can be used as digital, thermistor, current, or voltage inputs. In addition, TAC Xenta 422A is equipped with LED status indicators, one for each digital input, and manual override switches for the digital outputs. The LED colors, red or green, can be selected individually by altering the parameter settings in TAC Menta® graphical tool or manually at start up.

### FUNCTIONAL FEATURES

- Universal inputs provide installation flexibility
- Designed for TAC Vista and open standard LonWorks systems
- Perfect for distributed installations
- Manual override switches provide local bypass operation
- Cost-effective installation and maintenance using separate terminal base and plug-in electronic units
- Individually configurable using the TAC Menta programming tool

### SPECIFICATIONS

|                            |   |
|----------------------------|---|
| Operating voltage          | .24 V AC $\pm$ 20%, 50/60 Hz or<br>21.6-40 V DC   |
| Power consumption          | max. 4 W  |
| Ambient Temperature        |   |
| Storage                    | -20 °C to +70 °C (-4 °F to +158 °F)   |
| Operation                  | 0 °C to +50 °C (+32 °F to +122 °F)  |
| Humidity                   | max. 90% RH non-condensing  |
| Dimensions incl. base      | .90 x 110 x 77mm (3.5" x 4.3" x 3")   |
| Protocol                   | .FTT-10, LonTalk®   |
| Transmission rate          | .78 kbits/s   |
| Universal inputs           |   |
| Quantity                   | .4  |
| Duration of counting pulse | min. 20 ms  |
| Indication                 | .Status LEDs, red or green adjustable via<br>TAC Menta or manually at start up<br>(TAC Xenta 422A only) |
| As thermistor input:       | .NTC, 1800 ohm or 10 kohm at 25°C<br>(77°F)   |
| As voltage input           | .0 – 10 V DC  |
| As current input           | .0 (4) - 20 mA  |
| Digital outputs            |   |
| Quantity                   | .5  |
| Switching capacity         | .250V AC / 2A   |
| Manual switch              | .ON, AUTO, OFF (TAC Xenta 422A)   |
| Indication                 | .Status LEDs green (TAC Xenta 422A)   |

For further specifications, see technical data sheet.

### DESCRIPTION

- 0-073-0245-0 TAC Xenta 421A without LEDs, without manual override switches
- 0-073-0246-0 TAC Xenta 422A with LEDs, with manual override switches

### ACCESSORIES

- 0-073-0902-0 TAC Xenta 400 terminal part

# Programmable Controllers



## TAC Xenta 451A and 452A Universal Input and Analog Output Module

TAC Xenta 451A and 452A are Universal Input/Analog Output modules in the TAC Xenta family. They can be used as normal Xenta I/O modules or as certified LONMARK® devices.

Both modules have eight universal inputs and two analog outputs. The universal inputs can be used as digital, thermistor, current, or voltage inputs. In addition, the TAC Xenta 452A is equipped with LED status indicators - one for each universal input when used for digital inputs. There is also a manual override for the analog output values. The LED colors, red or green, can be selected individually by altering the parameter settings in the TAC Menta® graphical tool.

### FUNCTIONAL FEATURES

- Universal inputs provide installation flexibility
- Designed for TAC Vista and open standard LonWorks systems
- Perfect for distributed installations
- Manual override switches provide local bypass operation
- Cost-effective installation and maintenance using separate terminal base and plug-in electronic units
- Individually configurable using the TAC Menta programming tool

### SPECIFICATIONS

|                            |   |
|----------------------------|---|
| Operating voltage          | 24 V AC/DC $\pm 20\%$ , 50/60 Hz or 21.6-40 V DC                                |
| Power consumption          | max. 3 W  |
| Ambient Temperature        |   |
| Storage                    | -20 °C to +50 °C (-4 °F to +122 °F)   |
| Operation                  | 0 °C to +50 °C (+32 °F to +122 °F)  |
| Humidity                   | max. 90% RH non-condensing  |
| Dimensions incl. base      | 90 x 110 x 77mm (3.5" x 4.3" x 3")  |
| Protocol                   | FTT-10, LonTalk®  |
| Transmission rate          | 78 kbits/s  |
| Universal inputs           |   |
| Quantity                   | 8   |
| Duration of counting pulse | min. 80 ms  |
| Indication                 | Status LEDs, red or green adjustable via TAC Menta or manually (TAC Xenta 452A) |
| As thermistor input        | NTC, 1800 ohm or 10 kohm at 25°C (77°F)   |
| As voltage input           | 0 - 10 V DC   |
| As current input           | 0 (4) - 20 mA   |
| Analog outputs             |   |
| Quantity                   | 2   |
| Output signal              | 0 - 10 V DC   |
| Manual switch              | MAN, AUTO and Pot. 0 - 10 V (TAC Xenta 452A)                                    |

For further specifications, see technical data sheet.

### DESCRIPTION

- 0-073-0285-0 TAC Xenta 451A without LEDs, without manual switches
- 0-073-0286-0 TAC Xenta 452A with LEDs, with manual switches
- 0-073-0902-0 TAC Xenta 400 terminal part



# Programmable Controllers



## TAC Xenta 471 Analog Input Module

For connecting analog, active, current and voltage signals. The analog input module is only to be used in combination with the TAC Xenta 300/401 basic controllers.

### FUNCTIONAL FEATURES

- Universal inputs provide installation flexibility
- Designed for TAC Vista and open standard LonWorks systems
- Perfect for distributed installations
- Cost-effective installation and maintenance using separate terminal base and plug-in electronic units
- Individually configurable using the TAC Menta programming tool

### SPECIFICATIONS

Operating voltage . . . . . 24 V AC  $\pm 20\%$ , 50/60 Hz, 19 - 40V DC  
Power consumption . . . . . max. 10 W  
Dimensions incl. base . . . . . 90 x 110 x 77mm (3.5" x 4.3" x 3")  
Protocol . . . . . FTT-10, LonTalk®  
Transmission rate . . . . . 78 kbits/s

#### Ambient temperature

Storage. . . . .  $-20\text{ }^{\circ}\text{C}$  to  $+50\text{ }^{\circ}\text{C}$  ( $-4\text{ }^{\circ}\text{F}$  to  $+122\text{ }^{\circ}\text{F}$ )  
Operation . . . . .  $0\text{ }^{\circ}\text{C}$  to  $+50\text{ }^{\circ}\text{C}$  ( $+32\text{ }^{\circ}\text{F}$  to  $122\text{ }^{\circ}\text{F}$ )  
Humidity . . . . . max. 90% RH non-condensing

#### Analog inputs

Quantity . . . . . 8

#### Input signal

Current Input . . . . . 0(4) – 20 mA, Input resistance 20 ohm  
Internal power supply . . . . . 200 mA, max  
Voltage Input . . . . . 0 – 10V DC, Input resistance 100k ohm  
Max. Input voltage . . . . . 24 V DC

For further specifications, see technical data sheet.

### DESCRIPTION

- 0-073-0291-0 TAC Xenta 471
- 0-073-0902-0 TAC Xenta 400 terminal part

# Programmable Controllers



## TAC Xenta 491/492 Analog Output Module

For issuing analog actuating signals. The analog output module is only to be used in combination with the TAC Xenta 300/401 basic controllers. The TAC Xenta 492 is equipped with manual override switches for the analog outputs.

### FUNCTIONAL FEATURES

- Universal inputs provide installation flexibility
- Designed for TAC Vista and open standard LonWorks systems
- Perfect for distributed installations
- Manual override switches provide local bypass operation
- Cost-effective installation and maintenance using separate terminal base and plug-in electronic units
- Individually configurable using the TAC Menta programming tool

### SPECIFICATIONS

Operating voltage . . . . . 24 V AC/  $\pm 20\%$ , 50/60 Hz, 19 - 40V DC  
Power consumption . . . . . max. 2 W  
Dimensions incl. base . . . . . 90 x 110 x 77mm (3.5" x 4.3" x 3")  
Protocol . . . . . FTT-10, LonTalk®  
Transmission rate . . . . . 78 kbits/s

#### Ambient temperature

Storage . . . . .  $-20\text{ }^{\circ}\text{C}$  to  $+50\text{ }^{\circ}\text{C}$  ( $-4\text{ }^{\circ}\text{F}$  to  $+122\text{ }^{\circ}\text{F}$ )  
Operation . . . . .  $0\text{ }^{\circ}\text{C}$  to  $+50\text{ }^{\circ}\text{C}$  ( $+32\text{ }^{\circ}\text{F}$  to  $122\text{ }^{\circ}\text{F}$ )  
Humidity . . . . . max. 90% RH non-condensing

#### Analog outputs

Quantity . . . . . 8  
Output signal . . . . . 0 – 10 V DC  
Manual switch . . . . . MAN, AUTO and Pot. 0 – 10V DC  
(TAC Xenta 492)

For further specifications, see technical data sheet.

### DESCRIPTION

- 0-073-0301-0 TAC Xenta 491 without manual switches
- 0-073-0303-0 TAC Xenta 492 with manual switches
- 0-073-0902-0 TAC Xenta 400 terminal part

# Programmable Controllers



## FUNCTIONAL FEATURES

- Easy to use Operator Panel
- Backlit display with 4 X 20 alpha-numeric characters
- Supports TAC Xenta 100, 280, 300 and 400 series of controllers
- Downloadable character sets like Cyrillic.
- Communicates over the LonWorks network
- One OP panel can support a number of Xenta units
- The Operator panel can be snapped on the Xenta controller or mounted in the front of a cabinet

## TAC Xenta Operator Panel

For convenient local operation of TAC Xenta controllers. Input is via 6 control keys and information is displayed in the clear LCD display. The LCD display's background lighting can be switched off, if not required, by changing the relevant parameter. The operator panel is connected to the controller with a plug-and-socket connection and supplied with power through the cable connector. It can also be directly connected to the LonWorks network.

The user can access all controllers connected to the network from one connection. The operator panel allows the current operating status to be checked and allows changes to be made to setpoints, time schedules etc. without connecting to a central system. In addition to allowing mobile deployment, the unit also supports the convenient plug-in installation to a TAC Xenta controller or can be mounted into the switchgear cabinet door. Modern and functional design. Compliant with TAC Xenta 100, TAC Xenta 280, TAC Xenta 300 and TAC Xenta 401.

## SPECIFICATIONS

|                                |   |
|--------------------------------|---|
| Operating voltage . . . . .    | .24 V AC/DC ±20% from TAC Xenta or external |
| Power consumption . . . . .    | max. 0.5 W                                  |
| Dimensions incl. base. . . . . | 114 x 96 x 34mm (4.5" x 3.8" x 1.3")        |
| Protocol . . . . .             | FTT-10, LonTalk                             |
| Transmission rate . . . . .    | .78 kbits/s                                 |
| Ambient Temperature            |   |
| Storage . . . . .              | -20 °C to +50 °C (-4 °F to +122 °F)         |
| Operation . . . . .            | .0 °C to +50 °C (32 °F to +122 °F)          |
| Humidity . . . . .             | max. 90% RH non-condensing                  |
| Display . . . . .              | .4 x 20 characters alpha-numerical, backlit |
| Type of protection . . . . .   | IP 20 / IP 43                               |

For further specifications, see technical data sheet.

## DESCRIPTION

0-073-0907-2 TAC Xenta OP Operator Panel

## ACCESSORIES

0-073-0904-0 TAC Xenta OP mounting kit panel



# Zone Controllers





# TAC Xenta

## Zone Controllers

### FUNCTIONAL FEATURES

- Air-quality control with CO<sub>2</sub> measurement
- PI control with P-band and I-time setting
- Seven different types of operation
- Neutral zone between heating and cooling
- On demand override of the wall module by the occupancy sensor, window contact or bypass control switch
- Individual setpoint adjustment
- Zone sensors with the ability to connect to a TAC Xenta LonWorks Operator Panel
- LONMARK® certified

TAC Xenta zone controllers are individual room controllers based on LONWORKS® for controlling and optimizing secondary heating/cooling systems. The TAC Xenta zone controllers are specifically designed for zone applications and include hardware and software. The controllers can be adapted to individual requirements using the flexible configuration settings. Parameters can be set on site using the TAC Xenta Operator Panel or centrally using the TAC Vista central system. Room sensors with setpoint adjuster make on demand adjustments possible. Unlike traditional zone controllers, intelligent LONWORKS® based devices can also be controlled directly via the bus.

The individual room controllers are integral components in a building's automation system and communicate via the LONWORKS® bus with the TAC Xenta controllers and the TAC Vista central system. Dynamic data exchange allows on demand optimization of the primary systems while maintaining comfortable conditions. To ensure optimal functionality, individual room controllers and/or parameters can be organized into groups so that several controllers can be set simultaneously. Groups also allow statistical evaluations and can therefore optimize the whole system. All TAC Xenta individual room controllers are LonMark® certified and allow completely open communication with other systems within a LONWORKS® network.

# TAC Xenta Zone Controllers Overview

| Controllers                                     | Xenta 101-VF | Xenta 121-FC | Xenta 102-B               | Xenta 102-EF | Xenta 102-VF | Xenta 102-ES | Xenta 102-AX | Xenta 103-A     | Xenta 104-A | Xenta 110-D | Xenta 121-HP |
|---|--------------|--------------|---------------------------|--------------|--------------|--------------|--------------|-----------------|-------------|-------------|--------------|
| Applications                                    | Fan Coil     | Fan Coil     | Variable air volume (VAV) |              |              |              |              | Chilled Ceiling | Roof Top    | Dual Zone   | Heat Pump    |
| Heating & air conditioning                      | ▼            | ▼            |                           |              |              |              |              | ▼               |             |             | ▼            |
| 3 speed fan                                     | ▼            | ▼            |                           |              |              |              |              |                 |             |             | ▼            |
| On/ off fan                                     |              | ▼            |                           |              |              |              |              |                 |             |             | ▼            |
| VAV   |              |              |                           | ▼            | ▼            | ▼            | ▼            |                 |             |             |              |
| VAV with electric heater                        |              |              |                           | ▼            |              |              |              |                 |             |             |              |
| VAV with hot water battery                      |              |              |                           |              |              |              |              |                 |             |             |              |
| 0-10 V control                                  |              |              |                           |              |              | ▼            |              |                 |             |             |              |
| 3 point control                                 |              |              |                           |              |              |              | ▼            |                 |             |             |              |
| VAV with on-board actuator & airflow transducer |              |              |                           |              |              |              | ▼            |                 |             |             |              |
| Cooling control                                 | ▼            | ▼            |                           |              |              |              |              | ▼               |             | ▼           | ▼            |
| Changeover valve                                |              |              |                           |              |              |              |              |                 |             |             | ▼            |
| Isolation valve                                 |              |              |                           |              |              |              |              |                 |             |             | ▼            |
| Lighting control – on/off, dimming & brightness |              |              |                           |              |              |              |              |                 |             | ▼           | ▼            |
| Control of motorized blinds                     |              |              |                           |              |              |              |              |                 |             | ▼           | ▼            |
| Mode of operation                               |              |              |                           |              |              |              |              |                 |             |             |              |
| Comfort   | ▼            | ▼            | ▼                         | ▼            | ▼            | ▼            | ▼            | ▼               | ▼           |             | ▼            |
| Standby   | ▼            | ▼            | ▼                         | ▼            | ▼            | ▼            | ▼            | ▼               | ▼           |             | ▼            |
| Bypass  | ▼            | ▼            | ▼                         | ▼            | ▼            | ▼            | ▼            | ▼               | ▼           |             | ▼            |
| Unoccupied                                      | ▼            | ▼            | ▼                         | ▼            | ▼            | ▼            | ▼            | ▼               | ▼           |             | ▼            |
| Off   |              | ▼            | ▼                         | ▼            | ▼            | ▼            | ▼            | ▼               | ▼           | ▼           | ▼            |
| Master/slave                                    | ▼            | ▼            | ▼                         | ▼            | ▼            | ▼            | ▼            | ▼               |             |             | ▼            |
| Heating only                                    |              | ▼            |                           |              |              |              |              | ▼               |             |             | ▼            |
| Cooling only                                    |              | ▼            |                           |              |              |              |              | ▼               | ▼           |             | ▼            |
| Fan on  | ▼            | ▼            |                           |              |              |              |              |                 | ▼           |             | ▼            |
| Cooling/heating (changeover)                    |              | ▼            |                           |              |              |              |              |                 | ▼           |             | ▼            |
| Purge   |              | ▼            | ▼                         | ▼            | ▼            | ▼            | ▼            | ▼               |             |             |              |
| Morning heating                                 |              |              |                           |              |              |              | ▼            |                 |             |             | ▼            |
| Emergency pressurization/ depressurization      |              |              |                           |              |              |              | ▼            |                 |             |             |              |



## TAC Xenta 101-VF Fan Coil Unit Controller

LONMARK® certified individual room controllers for fan coil systems with heating and/or cooling. The heating/cooling switch can be centrally controlled, or controlled via the average temperature. Incoming air and room temperature can be controlled in sequence. Fans are controlled continuously, 3-speed or on-off depending on the fan coil controller type. The controller can be operated in a stand-alone system or within a LONWORKS® network.

PI control with individual P-band and I-time settings for heating and cooling can be set. Values can be monitored and parameters can be set centrally via the central system or remotely with the TAC Xenta Operator Panel.

### FUNCTIONAL FEATURES

- Various applications:  
Single-step control with cooling, heating or changeover operation for cooling/heating. Two-step control with cooling and heating in sequence. Fan control via 3-step relays, on/off or speed control.
- Slave function mode of operation and setpoint for several slave controllers are controlled by one master controller.
- Setpoint adjustment via a wall module with setpoint adjuster, or via a LONWORKS® network variable.
- Seven types of operation: comfort, stand-by, bypass, unoccupied, off, slave, fan only.
- Several fan operation modes.
- Min and Max values limit air flow.
- Alarm monitoring high or low room temperature, open window, temperature sensor error etc.
- Occupancy sensor, window contact and cool-down protection, CO<sub>2</sub> measurement input.

### SPECIFICATIONS

|                   |                                 |
|-------------------|---------------------------------|
| Operating voltage | 24 V AC or 230 V AC ±20%        |
| Power consumption | 4 VA                            |
| Dimensions        | 127 x 126 x 50mm (5" x 5" x 2") |

#### Ambient temperature

|                  |                                |
|------------------|--------------------------------|
| Operation        | 0°C to +50°C (32°F to 122°F)   |
| Storage          | -20°C to +50°C (-4°F to 122°F) |
| Humidity         | max. 90% RH non-condensing     |
| Enclosure rating | IP 30                          |

#### Inputs and outputs

|                       |                                |
|-----------------------|--------------------------------|
| Window contact        | Digital input                  |
| Occupancy sensor      | Digital input                  |
| Cooling valve         | 3-point, on/off or PWM control |
| Heating valve         | 3-point, on/off or PWM control |
| Fan                   | 3-step (250 V / 3 A) 101-VF    |
| Room temperature      | Thermistor input               |
| Inlet air temperature | Thermistor input               |
| Wall module           | As selected                    |

For further specifications, see technical data sheet.

### DESCRIPTION

- 0-073-0505-0 TAC Xenta 101-VF/24 Fan Coil Unit heating/cooling, Fan 3 steps
- 0-073-0507-0 TAC Xenta 101-VF/230 Fan Coil Unit heating/cooling, Fan 3 steps



# Zone Controllers



## TAC Xenta 102-B, 102-EF, 102-VF VAV Controllers

LONMARK® certified individual room controllers for VAV applications (Variable Air Volume) connected to an external air flow controller (Belimo VAV Compact). The controller keeps a constant temperature in the zone by controlling the air flow, optional heating stages, and fan in sequence. By using a carbon dioxide sensor, the air quality can be controlled in the zone. The controller can be operated stand-alone or within a LONWORKS® network. PI control with individual P-band and I-time setting for heating and cooling. Can be monitored and parameters can be set centrally via the central system or remotely with the TAC Xenta LONWORKS® Operator Panel.

### FUNCTIONAL FEATURES

- Various applications: Single-step control with setpoint calculation of an external air flow controller. Two-step setting with cooling and heating in sequence. Heating operation via an electric reheater or hot water.
- Slave function mode of operation and setpoint for several slave controllers are controlled by one master.
- Setpoint adjustment via a wall module with setpoint adjuster or via a LONWORKS® network variable.
- Seven modes of operation: comfort, standby, bypass, unoccupied, off, slave and purge mode.
- Air quality based adjustments.
- Configurable limit values MIN and MAX air flow limit.
- Alarm monitoring high or low room temperature, open window, temperature sensor error, etc.
- Occupancy sensor, window contact and cool-down protection, CO<sub>2</sub> measurement input.

### SPECIFICATIONS

|                             |                                    |
|-----------------------------|------------------------------------|
| Operating voltage . . . . . | 24 V AC ±20%                       |
| Power consumption . . . . . | 4 VA                               |
| Dimensions . . . . .        | 127 x 126 x 50mm<br>(5" x 5" x 2") |

#### Ambient temperature

|                            |                                |
|----------------------------|--------------------------------|
| Operation . . . . .        | 0°C to +50°C (32°F to 122°F)   |
| Storage . . . . .          | -20°C to +50°C (-4°F to 122°F) |
| Humidity . . . . .         | max. 90% RH non-condensing     |
| Enclosure rating . . . . . | IP 30                          |

#### Inputs and outputs

|                                  |   |
|----------------------------------|---|
| Window contact . . . . .         | Digital input                                   |
| Occupancy sensor . . . . .       | Digital input                                   |
| Air damper . . . . .             | 0 – 10 VDC                                      |
| Heating valve . . . . .          | 2-point output<br>(102-EF); 0 - 10 VDC (102-VF) |
| Room temperature . . . . .       | Thermistor input                                |
| Air flow . . . . .               | 0 – 10 VDC                                      |
| CO <sub>2</sub> sensor . . . . . | 0 – 10 VDC                                      |
| Wall module . . . . .            | As selected                                     |

For further specifications, see technical data sheet.

### DESCRIPTION

- 0-073-0531-0 TAC Xenta 102-B VAV Controller
- 0-073-0533-0 TAC Xenta 102-EF VAV Controller electrical reheat
- 0-073-0535-0 TAC Xenta 102-VF VAV Controller valve reheat

# Zone Controllers



## TAC Xenta 102-ES VAV Controller

LONMARK® certified individual room controller for VAV applications (Variable Air Volume flow) connected to an external air flow sensor (TAC GV). The controller is intended primarily for VAV cooling applications with one or two stages of reheating. The controller keeps a constant temperature in the zone by controlling the air flow and heating stages. By using a carbon dioxide sensor, the air quality can be controlled in the zone. The controller can be operated stand-alone or within a LONWORKS® network. PI control with individual P-band and I-time setting for heating and cooling. Can be monitored and parameters can be set centrally via the central system or remotely with the TAC Xenta Operator Panel.

### FUNCTIONAL FEATURES

- Various applications: Single-step control via external air flow sensor and heating in sequence. Heating operation by modulating hot water radiator valve.
- Slave function mode of operation and setpoint for several slave controllers are controlled by one master.
- Setpoint adjustment via a wall module with setpoint adjuster or via a LONWORKS® network variable.
- Seven modes of operation: comfort, standby, bypass, unoccupied, off, slave and purge mode.
- Air quality based adjustments.
- Configurable limit values MIN and MAX air flow limit.
- Alarm monitoring high or low room temperature, open window, temperature sensor error, etc.
- Occupancy sensor, window contact and cool-down protection, CO<sub>2</sub> measurement input.

### SPECIFICATIONS

|                             |                                 |
|-----------------------------|---------------------------------|
| Operating voltage . . . . . | 24 V AC ±20%                    |
| Power consumption . . . . . | 4 VA                            |
| Dimensions . . . . .        | 127 x 126 x 50mm (5" x 5" x 2") |

|                     |                                |
|---------------------|--------------------------------|
| Ambient temperature |                                |
| Operation . . . . . | 0°C to +50°C (32°F to 122°F)   |
| Storage . . . . .   | -20°C to +50°C (-4°F to 122°F) |
| Humidity . . . . .  | max. 90% RH non-condensing     |

|                            |       |
|----------------------------|-------|
| Enclosure rating . . . . . | IP 30 |
|----------------------------|-------|

|                                  |                   |
|----------------------------------|-------------------|
| Inputs and outputs               |                   |
| Window contact . . . . .         | Digital input     |
| Occupancy sensor . . . . .       | Digital input     |
| Air damper . . . . .             | 3-point output    |
| Heating valve . . . . .          | 3-point or on/off |
| Room temperature . . . . .       | Thermistor input  |
| Air flow sensor . . . . .        | Tube connection   |
| CO <sub>2</sub> sensor . . . . . | 0 – 10 VDC        |
| Wall module . . . . .            | As selected       |
| Optional . . . . .               | Temperature input |

For further specifications, see technical data sheet.

### DESCRIPTION

0-073-0537-0 TAC Xenta 102-ES VAV Controller valve reheat

# Zone Controllers



## TAC Xenta 102-AX VAV Controller

### with Onboard Actuator and Air Flow Transducer

TAC Xenta 102-AX is a LONMARK® compliant individual room controller intended for VAV heating and cooling applications with one or two stages of reheating. The controller keeps a constant temperature in the zone by controlling the air flow and heating stages. By using a carbon dioxide sensor, the air quality can be controlled in the zone. TAC Xenta 102-AX is equipped with an integrated, static air velocity transducer and a motorized bidirectional actuator in a single package. The differential pressure air velocity transducer requires a minimum of maintenance. Thus it is also well suited to be placed in the zone return air duct.

#### FUNCTIONAL FEATURES

- Various applications:  
Single-step VAV controller via internal air flow sensor and heating in sequence up to 3 stages.
- Setpoint adjustment via STR 200, 202 or 250 wall modules or via a LONWORKS® network variable.
- Seven modes of operation: occupied, standby, bypass, unoccupied, morning warm up, purge mode and emergency pressurization/depressurization.
- Air quality based adjustments.
- Fan control can be enabled/disabled either in parallel or serial mode.
- Alarm monitoring high or low room temperature, open window, temperature sensor error, etc.
- Occupancy sensor, CO<sub>2</sub> measurement input.

#### SPECIFICATIONS

Operating voltage . . . . . 24 V AC ±20%  
Power consumption . . . . . 8 VA  
Dimensions. . . . . 197 x 159 x 63mm (7.7" x 6.3" x 2.5")

#### Ambient temperature

Operation. . . . . 0°C to +50°C (32°F to 122°F)  
Storage. . . . . -20°C to +50°C (-4°F to 122°F)  
Humidity . . . . . max. 90% RH non-condensing  
Enclosure rating . . . . . IP 30

#### Inputs and outputs

Occupancy sensor . . . . . Digital input  
Reheater. . . . . Triac 24 V AC, voltage sourcing, max. 0.75 A  
Torque . . . . . 6 Nm  
Stroke. . . . . 0 – 90 degrees  
Timing . . . . . 2.4 sec/degree rotation (50 Hz)  
Temperature. . . . . Thermistor input 10k ohm NTC  
Wall module. . . . . As selected

For further specifications, see technical data sheet.

#### DESCRIPTION

0-073-0540-1 TAC Xenta 102-AX VAV Controller with Actuator and Air Flow Transducer

#### ACCESSORIES

- 0-046-300-0 STR200 Wall Module
- 0-046-301-0 STR200-W Wall Module (White)
- 0-046-320-0 STR202 Wall Module
- 0-046-330-0 STR250 Wall Module

# Zone Controllers



## TAC Xenta 103-A Chilled Ceiling Controller

LONMARK® certified individual room controller for chilled ceiling applications. The controller keeps a constant temperature by modulating the cold water flow to the ceiling elements, the hot water flow to the radiators, and the air flow through the damper. The controller can be operated on a stand-alone basis or within a LONWORKS® network. PI control with individual P-band and I-time setting for heating and cooling. Can be monitored and parameters can be set centrally via the central system, or remotely via the TAC Xenta Operator Panel. Air-quality based adjustments when a CO<sub>2</sub> sensor is connected.

### FUNCTIONAL FEATURES

- Various applications:  
Room temperature control via chilled ceiling, in sequence with damper and radiator valve modulating the hot water. Choice of heating/cooling, only heating or only cooling (water and/or air).
- Slave function mode of operation and setpoint for several slave controllers are controlled by one master controller.
- Setpoint adjustment via a wall module with setpoint adjuster or via a LONWORKS® network variable.
- Seven modes of operation: comfort, standby, bypass, unoccupied, off, slave and purge mode.
- Air quality based adjustments.
- Configurable limit values.
- Alarm monitoring high or low room temperature, open window, temperature sensor error etc.
- Occupancy sensor, window contact and cool-down protection, CO<sub>2</sub> measurement input.

### SPECIFICATIONS

|                             |                                 |
|-----------------------------|---------------------------------|
| Operating voltage . . . . . | 24 V AC ±20%                    |
| Power consumption . . . . . | 4 VA                            |
| Dimensions. . . . .         | 127 x 126 x 50mm (5" x 5" x 2") |

|                            |                                |
|----------------------------|--------------------------------|
| Ambient temperature        |                                |
| Operation. . . . .         | 0°C to +50°C (32°F to 122°F)   |
| Storage. . . . .           | -20°C to +50°C (-4°F to 122°F) |
| Humidity . . . . .         | max. 90% RH non-condensing     |
| Enclosure rating . . . . . | IP 30                          |

|                                    |                   |
|------------------------------------|-------------------|
| Inputs and outputs                 |                   |
| Window contact/hygrostat . . . . . | Digital input     |
| Occupancy sensor . . . . .         | Digital input     |
| Cooling valve . . . . .            | 0 – 10 VDC        |
| Air damper. . . . .                | 0 – 10 VDC        |
| Heating valve. . . . .             | 3-point or on/off |
| Room temperature. . . . .          | Thermistor input  |
| CO <sub>2</sub> sensor. . . . .    | 0 – 10 VDC        |
| Wall module. . . . .               | As selected       |

For further specifications, see technical data sheet.

### DESCRIPTION

0-073-0561-0 TAC Xenta 103-A Chilled Ceiling Controller



## TAC Xenta 104-A Roof Top Unit Controller

LONMARK® certified controller for small air handling systems and roof top units for heating, cooling and heat recovery. The room temperature is held at a constant temperature with sequential control of the heating, cooling and heat recovery functions. Inlet air and room air temperature can be set in cascade. The fan mode may be selected to operate continuously during the occupied mode, or cycle with heating or cooling demand from the zone. PI control action with individual P-band and I-time setting for heating and cooling. The controller can be operated on a stand-alone basis or within a LONWORKS® network. Can be monitored and parameters can be set centrally via the central system or remotely via the TAC Xenta Operator Panel.

### FUNCTIONAL FEATURES

- Various applications: Single-step control with cooling, heating or changeover operation for cooling/heating. Two-step control with sequential cooling and heating.
- Three-point control of the heating and cooling valves.
- Relay output for fan control.
- Setpoint adjustment via a wall module with set point adjuster or via a LONWORKS® network variable.
- Various modes of operation: heating only, cooling only, fan only, cooling/heating (changeover), on, unoccupied, standby and bypass.
- Various types of fan operation.
- Configurable limit values MIN and MAX limit the inlet air temperature.
- Alarm monitoring high or low room temperature, temperature sensor error, fan error, etc.

### SPECIFICATIONS

|                             |                                    |
|-----------------------------|------------------------------------|
| Operating voltage . . . . . | 24 V AC ±20%                       |
| Power consumption . . . . . | 4 VA                               |
| Dimensions. . . . .         | 126 x 122 x 50 mm (5" x 4.8" x 2") |

|                     |                                 |
|---------------------|---------------------------------|
| Ambient temperature |                                 |
| Operation. . . . .  | -25°C to +50°C (-13°F to 122°F) |
| Storage . . . . .   | -25°C to +50°C (-13°F to 122°F) |
| Humidity . . . . .  | max. 90% RH non-condensing      |

|                            |       |
|----------------------------|-------|
| Enclosure rating . . . . . | IP 30 |
|----------------------------|-------|

#### Inputs and outputs

|                                       |                        |
|---------------------------------------|------------------------|
| Fan alarm/status . . . . .            | 2 digital inputs       |
| Cooling valve . . . . .               | 3-point output         |
| Heating valve . . . . .               | 3-point or 2 stages    |
| Fan control. . . . .                  | Relay output 24 V / 2A |
| Room temperature . . . . .            | Thermistor input       |
| Inlet air temperature. . . . .        | Thermistor input       |
| Discharge/mixed temperature . . . . . | Thermistor input       |
| Wall module. . . . .                  | As selected            |

For further specifications, see technical data sheet.

### DESCRIPTION

0-073-0591-0 TAC Xenta 104-A Roof Top Unit Controller

# Zone Controllers



## TAC Xenta 110-D Dual Zone Controller

LONMARK® certified individual room controllers for cost-effective individual room solutions of climate control, lighting control, dimming and window control. Seven LONMARK® profiles are available for various applications. Configuring these as master or slave controllers means that zone/group requirements can be generated, and that they can interact with additional controllers in the TAC Xenta 100 family. The controller can be operated on a stand-alone basis or within a LONWORKS® network. Can be monitored and parameters can be set centrally via the central system or remotely with the TAC Xenta Operator Panel.

### FUNCTIONAL FEATURES

- Various applications:  
Single-step control with cooling or heating.
- Two-step control with cooling and heating in sequence, two-point control of the heating and cooling valves.
- Light control on/off, dimming and brightness control with lux sensor.
- Window control opening/closing and window contact, interlock of the window contacts with blind stop.
- Occupancy detection via digital input or LONWORKS® network variable (SNVT).
- Possibility of combining with TAC Xenta 101, TAC Xenta 102, TAC Xenta 103 and TAC Xenta 104 for a wide range of individual room applications.
- Operation options via direct inputs for conventionally connected switches and setpoint adjuster or via LONWORKS® network variables from a room control panel or via the virtual control panel, TAC Vista ScreenMate, on the Intranet.

### SPECIFICATIONS

Operating voltage . . . . . 24 V or 230V AC  $\pm 20\%$   
 Power consumption . . . . . 4 – 80 VA  $\pm 10\%$   
 Dimensions . . . . . 126 x 122 x 50mm (5" x 4.8" x 2")

Ambient temperature  
 Operation . . . . . 0°C to +50°C (32°F to 122°F)  
 Storage . . . . . –20°C to +50°C (–4°F to 122°F)  
 Humidity . . . . . max. 90% RH non-condensing  
 Enclosure rating . . . . . IP 30

Inputs  
 Setpoint adjuster . . . . . 2 x 10 kohm potentiometer  
 Zone temperature . . . . . 2 x thermistor NTC, 1800 ohms at 25°C (77°F)  
 Bypass, light, occupancy . . . . . 3 x digital

Outputs  
 Dimming . . . . . 1 x 0 – 10 V, max 2 mA  
 Light control . . . . . 4 x relay, 250 V 3 A (resistive), 250W (HF Lamps)  
 Heating/cooling valve . . . . . 4 x triac for thermal actuators,  
 110-D/24 max 0.8 A  
 110-D/230 max 0.5 A

For further specifications, see technical data sheet.

### DESCRIPTION

- 0-073-0601-0 TAC Xenta 110-D/24 Dual Zone Controller
- 0-073-0603-0 TAC Xenta 110-D/230 Dual Zone Controller

# Zone Controllers



## TAC Xenta 121-FC Programmable Fan Coil Controller

TAC Xenta 121-FC is an easily programmable controller intended for both 2-pipe and 4-pipe applications, with or without re-heat. It can be configured for use with a multitude of valve actuator types, such as on/off, multistage, increase/decrease, PWM, etc. The controller has different types of fan control and advanced fan control functions, including on/off delays, boosting and conditioning.

### FUNCTIONAL FEATURES

- The controller is designed for both 2 and 4 pipe installations
- Multi-functional Heating and Cooling: heating, cooling and secondary heating
- Multi-stage Fan Control: up to three stages or analog speed control
- Indoor Air Quality Control: full support for CO<sub>2</sub> and RH (Relative Humidity) functions
- Exception modes take care of abnormal conditions like fire or risk of frost
- Configurable In- and Outputs: all inputs and outputs are configurable to minimize installation cost

The sequences for cooling, heating and fan are completely user programmable, allowing for numerous different applications. For energy savings the controller has built-in economizer functionality. Use TAC Xenta 121-FC with any TAC STR room unit.

Set-up is done using the programming tool TAC ZBuilder, which can be run stand-alone or as a device plug-in to either TAC Vista or LNS. The configuration settings are downloaded into a TAC Xenta 120, prepared with the necessary basic application software.

The controller is a LONMARK® compliant device aimed at communicating on a LonTalk® TP/FT-10 channel. It is able to operate both as a stand-alone device and as part of a system. Input and output network variables can be monitored via the TAC Xenta OP, but programming relies on the use of the TAC ZBuilder.

### SPECIFICATIONS

Operating voltage

FC/24 . . . . . 24 V AC ±20%, 50–60 Hz

FC/230 . . . . . 230 V AC ±10%, 50–60 Hz

Power consumption . . . . . 5 VA

Dimensions . . . . . 126 x 122 x 50mm (5" x 4.8" x 2")

Ambient temperature

Operation . . . . . 0°C to +50°C (32°F to 122°F)

Storage . . . . . –20°C to +50°C (–4°F to 122°F)

Humidity . . . . . max. 90% RH non-condensing

Enclosure rating . . . . . IP 30

Digital inputs . . . . . 3, (X1-X3) NO/NC

Thermistor inputs. . . . . 2, (B1-B2) NTC 1.8 kohm at 25°C (77°F)

Universal input. . . . . 1, (U1), configurable as thermistor, digital or analog input

Potentiometer input. . . . . 1, (R1) 10 kohm

Triac outputs . . . . . 4, (V1-V4) 24 V AC Intern. supplied

Relay outputs. . . . . 3, (K1-K3) 250 V AC, 3A

Relay output . . . . . 1 (K4) FC24 24 V AC, FC230 250VAC, 3A

Voltage output. . . . . 1 (Y1) 0-10 V DC

### DESCRIPTION

0-073-0621-0 Contr Zone TAC Xenta 121-FC/24

0-073-0622-0 Contr Zone TAC Xenta 121-FC/230

0-073-0914-0 LNS Plug-in



## TAC Xenta 121- HP Programmable Heat Pump Application

The sequences for cooling, heating and fan are completely user programmable, allowing for numerous different applications. For energy savings, the controller has built-in economizer functionality. Use TAC Xenta 121-HP with any TAC STR room unit. Set-up is done using the programming tool TAC ZBuilder, which can be run stand-alone or as a device plug-in to either TAC Vista or LonMaker®. The configuration settings are downloaded into a TAC Xenta 100, prepared with the necessary basic application software. The controller is a LONMARK® compliant device aimed at communicating on a LonTalk® TP/FT-10 channel. It is able to operate both as a stand-alone device and as part of a system. In- and output network variables can be monitored via the TAC Xenta OP.

### FUNCTIONAL FEATURES

- The controller is designed for both water-sourced and air-sourced heat pump installations
- Multi-functional Heating and Cooling: the controller handles heating, cooling and secondary heating
- Multi-stage Fan Control: The Xenta 121 controller handles up to three stages or analog speed control
- Indoor Air Quality Control functions:  
Full support for CO<sub>2</sub> and RH (Relative Humidity) functions
- Exception modes take care of abnormal conditions like fire, compressor lockout or risk of frost
- Handles reversing and isolation valves
- Configurable In- and Outputs: All inputs and outputs are configurable to minimize installation cost

### SPECIFICATIONS

#### Supply Voltage

HP/24 . . . . . 24 V AC ±20%, 50–60 Hz

HP/230 . . . . . 230 V AC ±10%, 50–60 Hz

Power consumption . . . . . 5 VA

Dimensions . . . . . 126 x 122 x 50mm (5" x 4.8" x 2")

#### Ambient temperature

Operation . . . . . 0°C to +50°C (32°F to 122°F)

Storage . . . . . –20°C to +50°C (–4°F to 122°F)

Humidity . . . . . max. 90% RH non-condensing

Enclosure rating . . . . . IP 30

Digital inputs . . . . . 3, (X1-X3) NO/NC

Thermistor inputs. . . . . 2, (B1-B2) NTC 1.8 kohm at 25°C (77°F)

Universal input. . . . . 1, (U1), configurable as thermistor, digital or analog input

Potentiometer input. . . . . 1, (R1) 10kohm

Triac outputs . . . . . 4, (V1-V4) 24 V AC Intern. supplied

Relay outputs. . . . . 3, (K1-K3) 250 V AC, 3A

Relay output . . . . . 1 (K4) HP24 24 V AC, HP230 250VAC, 3A

Voltage output. . . . . 1 (Y1) 0-10 V DC

### DESCRIPTION

0-073-0631-0 Contr Zone TAC Xenta 121-HP/24

0-073-0632-0 Contr Zone TAC Xenta 121-HP/230

0-073-0914-0 LNS Plug-in



# Zone Controllers



## TAC Xenta OP LONWORKS® Operator Panel

For convenient local operation of TAC Xenta controllers and individual room controllers. Input is via 6 control keys. Information is shown on a clear LCD display. The background lighting of the LCD can be switched off by changing the relevant parameter. The Operator Panel is connected to the individual room controller via a wall module and supplied with power via a connecting cable. Alternatively, a direct connection to the LONWORKS® network is also possible. The user has access to all TAC Xenta units connected to the network via one TAC Xenta OP. The Operator Panel allows the current operating status to be checked and changes to be made to setpoints, limit values, parameters etc., without connecting to a central system. The modern and functional design supports a variety of mounting options allowing mobile deployment.

### FUNCTIONAL FEATURES

- Accesses the TAC Xenta network for values, parameters, alarms and time schedules
- Supports local characters
- Access Xenta 100/120 via STR module
- Any LONWORKS device can be connected
- Silicone buttons

### SPECIFICATIONS

|                                 |  |
|---------------------------------|--|
| Operating voltage . . . . .     | 24 V AC/DC from the TAC Xenta or external  |
| Power consumption . . . . .     | max. 0.5 W                                 |
| Dimensions. . . . .             | 144 x 96 x 34mm (4.5" x 3.8" x 1.3")       |
| Ambient Temperature             |  |
| Storage. . . . .                | -20 °C to +50 °C (-4 °F to +122 °F)        |
| Operation. . . . .              | 0 °C to +50 °C (32 °F to +122 °F)          |
| Humidity . . . . .              | max. 90% RH non-condensing                 |
| Display . . . . .               | 4 X 20 characters alpha-numerical, backlit |
| Enclosure rating . . . . .      | IP 20 / IP 43                              |
| Network communication . . . . . | FTT-10, LONWORKS®                          |
| Transmission rate . . . . .     | 78 kbit/s                                  |

For further specifications, see technical data sheet.

### DESCRIPTION

**0-073-0907-2 TAC Xenta OP Operator Panel**

### ACCESSORIES

**0-073-0904-0 TAC Xenta OP mounting kit panel**



# Security





# TAC Vista

## Security Controllers

TAC Vista Security provides a complete security solution that is fully integrated with Vista, using your building's administrative TCP/IP network. Security devices and building control devices can share information, connected through a common architecture and network.

### **SIMPLE TO INSTALL**

TAC Vista Security is designed to be easy to install. Adding this solution to your Vista system is as simple as ordering the license option, then connecting the security hardware devices using the TAC Xenta 527 embedded web and infrastructure product. This same product provides field integration with Xenta LONWORKS® networks as well as providing security integration with TAC Vista.

### **EASY TO CONFIGURE**

Only a limited amount of user intervention is needed to establish devices on the network. The configuration is intuitive and simple. You just add a TAC Xenta 527 to the Vista device list, and the rest of the setup process is primarily automated.

### **POWERFUL TO USE**

By making use of TAC's experience in security solutions, TAC Vista Security gives users a system that is easy to operate yet provides extremely powerful security capabilities. TAC Vista Security allows comprehensive access control and well designed functions that permit intruder detection monitoring to be established where needed. The open protocol and multiple secondary protocol connections mean that interfaces to, for example fire systems thru MODBUS, are easy to achieve.



## TAC Xenta 527

The TAC Xenta 527 is a comprehensive presentation system, which enables secure web access to both TAC I/NET Seven and TAC Vista™ networks simultaneously. It provides you with the freedom to monitor your system from any location with Internet access. With automatic network discovery of TAC I/NET systems, the only configuration needed is to point the Xenta 527 to TAC I/NET's NetPlus™ Routers or TAC I/NET Hosts. After that, your entire TAC I/NET network is immediately available through the web interface.

You can access any point in your system, either through the convenient browse functionality, or via a graphic page link. Comprehensive control features include changing values such as set points, optimization parameters, and PID parameters. Manual control features such as test, hold, and manual are all supported as well as acknowledge, and momentary release for doors.

### FUNCTIONAL FEATURES

- Real time graphics and dynamic data
- Simultaneous presentation of TAC I/NET and TAC Vista systems
- Trend logging and analysis
- Time scheduling
- Time synchronization
- Alarm management
- Alarm notification via email
- Device mode management
- Event viewing and filtering
- Point control
- Operator security
- Personal home page
- Wireless sensor support
- Embedded Net Plus router
- Peer to Peer linking of TAC I/NET to LON signals
- Configurable Encryption for TAC I/NET I/P communications
- Supports DNS and DHCP configurations
- Comprehensive SNMP integration
- On-board Controller LAN connection

### SPECIFICATIONS

Supply voltage . . . . .24 V AC ±20%, 50/60 Hz or 19–40 V DC  
 Power consumption . . . . .max. 5 W  
 Transformer sizing . . . . .5 VA

#### Ambient Temperature

Storage. . . . . –20 °C to +50 °C (–4 °F to +122 °F)  
 Operation. . . . . 0 °C to +50 °C (+32 °F to +122 °F)  
 Humidity . . . . .max. 90% RH non-condensing

#### Mechanical

Dimensions. . . . .90 x 110 x 77mm (3.5" x 4.3" x 3")  
 Weight. . . . .0.2 kg (0.44 lb.)  
 Enclosure rating . . . . .IP 20

#### Real Time Clock

Accuracy at +25 °C (77°F) . . . . ±12 minutes per year  
 Power failure protection. . . . .72 h

#### Communication

A: RS232 . . . . .2400 – 57600 bps, RJ45, 8-p  
 A: RS485 . . . . .2400 – 57600 bps, async. terminal block  
 B: RS232 . . . . .RJ10, 4-p  
 C: RS485 . . . . .sync. (SDLC) terminal block  
 LonWorks. . . . .TP/FT-10, terminal block  
 Ethernet . . . . .TCP/IP, 10Base-T, RJ45

#### Memory

Internal memory. . . . .16 MB  
 External memory . . . . .expandable with MMC  
 (4 – 128 MB, MMC card)


### DESCRIPTION

0-073-0820-0 Electrical part TAC Xenta 527

### ACCESSORIES

0-073-0902-0 Terminal part TAC Xenta 400

0-073-0920-0 TAC Xenta: Programming Serial Kit

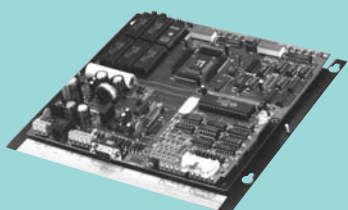

## 7790A MCI MicroController Interface

The TAC I/NET™ 7790A MicroController Interface provides a “Gateway” between TAC’s token passing, Peer-to-Peer Controller LAN and a network of standalone MicroControllers. The MCI also functions as a network controller for a standalone system. The MCI provides global functions for the MicroControl Units. These global functions include: Access Initiated Control, Elevator Control, Event Initiated Control, Trending, Runtime Accumulation, Automatic Time Scheduling, Calculations, Anti-Passback and periodic synchronization of the local clocks in the MicroControl Units.

### FUNCTIONAL FEATURES

- Integration
  - Environmental
  - Access Control
  - General Purpose
- MicroControl units supported
  - 123 Series MicroRegulators™
  - SCU1284 Security Control Unit
  - SCU1280 Security Control Unit
  - SCU1200 Security Control Unit
- Peer-to-Peer, Token Passing LAN standard
- Dual MicroController Sub-LANs
  - 16 SCUs per MCI
  - 64 MRs per MCI
  - 64 MicroControl Units per MCI (SCU and MR combined)
  - Mix and Match Controllers on the Sub-LANs
- Counter-Scanning Loop Option
- Front End Controller for Standalone System
  - Supports up to 64 Doors
  - Supports up to 64 HVAC Equipment Units
- Remote Operation over Dial-Up Phone Lines
- Fiber Optic Compatible
- Local Ports for PC or Modem
- Auto Dial/Auto Answer Modem-Option Board
- Modular, Object-Oriented Programming
- Gateway for Global Control Functions
- Resident Programs for:
  - Access Initiated Control
  - Elevator Control
  - Environmental Control
  - Energy Management
  - Historical Data Collection

### SPECIFICATIONS

|                             |   |
|-----------------------------|---|
| Operating voltage . . . . . | 24 V AC                                     |
| Power consumption . . . . . | 40 VA max.                                  |
| Dimensions . . . . .        | 245 x 255 x 15mm<br>(9.65" x 10" x 0.6")    |
| Channels . . . . .          | 2 per MCI                                   |
| Controllers . . . . .       | Maximum 64<br>MicroControl Units<br>per MCI |

### DESCRIPTION

**7790A-C MicroController Interface – Baseplate Mounted**

### ACCESSORIES

- RS232EXP-C Synchronous two-way modem card (w/o modem) – Plugs on to 7790 base card**
- CBL072 Cable, Controller DE9 to PC DE9, 6 ft (1.83 m)**
- CBL074 Cable, Controller DE9 to Modem DB25, 6 ft (1.83 m)**
- TCON109 7790 LAN Interface Unit Installation Guide – Hardware platform for MCI**



## 7798 I/SITE™ LAN Integrated Site Controller

The 7798 I/SITE LAN is a standalone unit that uses the MicroRegulator™ (MR) and Security Control Unit (SCU) controllers to provide building management services targeted at the requirements of managing smaller buildings or buildings in remote locations. The 7798 I/SITE LAN allows the operator or building manager to control the building through a ViewCon, a local host PC connection, a modem to a remote PC or an optional TAC Controller LAN network. When connected to a TAC I/NET™ host PC via modem, direct connection or optional controller LAN network, the I/SITE LAN becomes an interface between the MR and DPU sub-controllers and a larger TAC I/NET Distributed Control System. The I/SITE™ LAN supports up to eight telephone numbers for use with the AA/AD modem function.

The I/SITE LAN provides global functions for the MRs and DPUs. These global functions include: Access Initiated Control, Anti-Passback, Demand Control, Event Initiated Control, Trending, and Runtime.

### FUNCTIONAL FEATURES

- ViewCon™ keypad display
  - Built-in operator interface
  - Custom pages & standard summaries
  - Password protected
- Sub-LAN port for connection of up to 32 MicroRegulators™ and/or Door Processor controllers in any combination
  - Open or closed loop sub-LAN
  - Communications through both primary and alternate paths
- Local Port for PC or Printer
- Local Port for Auto Dial/Auto Answer modem
- Attractive plastic enclosure suitable for wall mounting in public areas
- Controller LAN option board
  - Global control functions
  - Peer-to-Peer, token passing network
- Trends all connected points
- Modular, Object-Oriented Programming
- Resident programs for:
  - Access Control
  - Environmental Control with DDC
  - Energy Management
  - Historical Data Collection

### SPECIFICATIONS


|                             |  |
|-----------------------------|--|
| Operating voltage . . . . . | 24 V AC  |
| Channels . . . . .          | 1 per I/SITE LAN                                     |
| Controllers . . . . .       | Maximum 32 MicroController units per 7798 I/SITE LAN |

### DESCRIPTION

**7798B1-C I/SITE LAN Integrated Site Controller**

### ACCESSORIES

|                |  |
|----------------|--|
| <b>CLX-C</b>   | <b>I/SITE Controller LAN Expansion Option, RS-485 – Plugs on to 7798 base unit</b> |
| <b>CBL072</b>  | <b>Cable, Controller DB9 to PC DB9, 6 ft (1.83m) – 9-pin Serial Cable</b>          |
| <b>CBL074</b>  | <b>Cable, Controller DB9 to Modem DB25, 6 ft (1.83m) – 25-pin Modem Cable</b>      |
| <b>XFMR6</b>   | <b>Transformer 120 Vac Primary, 24 V/2.4 A Secondary</b>                           |
| <b>XFMR7</b>   | <b>Transformer 240 Vac Primary, 24 V/2.4 A Secondary</b>                           |
| <b>TCON138</b> | <b>Model 7798 I/SITE LAN Installation Guide</b>                                    |

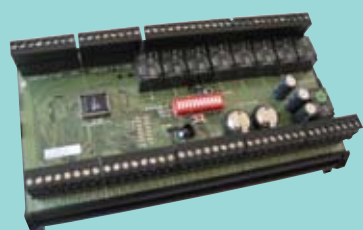

## TAC I/NET Security Control Unit Models 1284, 1280, 1200

The SCU (Security Control Unit) family of modular, stand-alone controllers are basic building blocks of the I/NET Seven Security Management System, and provide a flexible mix of door control and alarm monitoring features. Three versions of the SCU are available. The SCU1284 is a door controller for up to 4 doors, with 12 supervised inputs and 8 Form C relay outputs. The SCU1280 is an input output controller with 12 supervised inputs and 8 Form C relay outputs. The SCU1200 is an input controller with 12 supervised inputs. All SCUs function as either stand-alone devices or as part of a larger local area network (LAN) host system.

### FUNCTIONAL FEATURES

- Robust, stand-alone four-door access controller
- Up to four readers and four doors per controller for flexible configurations
- Flash memory for easy online software updates
- Supports two-man rule and escorted access for increased security
- Configurable audio tones to indicate valid card read, invalid card read, and other types of events
- Large alarm buffer protects integrity of alarm data
- Small footprint for easy installation
- Dynamic memory management allows maximum storage of card holders and transactions
- Wide range of enclosures, battery options, and power options lowers installation costs

### SPECIFICATIONS

|                                   |  |
|-----------------------------------|--|
| Operating voltages                |  |
| SCU12xxE1 . . . . .               | 115 V AC                                       |
| SCU12xxE2 . . . . .               | 115 V AC / optional battery                    |
| SCU12xxE3 . . . . .               | 230 V AC                                       |
| Power consumption                 |  |
| SCU12xx . . . . .                 | 24 V AC 1.2A max                               |
| SCU12xxE1 or E2 . . . . .         | 115 V AC 75 VA max                             |
| SCU12xxE3 . . . . .               | 230 V AC 75VA max<br>(50/60 Hz ±15%)           |
| Dimensions                        |  |
| Mounted controller Size . . . . . | 216 x 127 x 64mm<br>(8.5" x 5" x 2.5")         |
| Enclosure type . . . . .          | Nema 1 (IP10) Style - Indoor                   |
| Size . . . . .                    | 362 x 413 x 108mm<br>(14.25" x 16.25" x 4.25") |
| Inputs and outputs . . . . .      | 14 inputs, 8 outputs                           |

### DESCRIPTION

|           |                                 |
|-----------|---------------------------------|
| SCU1200   | 12 Input Controller             |
| SCU1280   | 12 Input 8 Output Controller    |
| SCU1284   | 12In 8Out 4Door 4Read Control   |
| SCU1200E1 | 12DI DIN With transformer       |
| SCU1280E1 | 12DI 8DO DIN With transformer   |
| SCU1284E1 | 4 Read 12DI 8DO DIN,transformer |
| SCU1200E2 | 12DI DIN, transformer, battery  |
| SCU1280E2 | 12DI 8DO DIN, transformer, batt |
| SCU1284E2 | 4Read 12DI 8DO DIN,transf,batt  |
| SCU1200E3 | 12DI 8DO DIN 230V,transformer   |
| SCU1280E3 | 12DI 8DO DIN With transformer   |
| SCU1284E3 | 4Read 12DI 8DO DIN 230V,transf  |

### ACCESSORIES

Recommended enclosure Model ENCLSCU  
 Recommended transformers Mounting in ENCLSCU enclosure Model XFMR6 (115V) Model XFMR7 (220/240V)  
 DIN rail mounting Model TR32 (220/240V)





## 7798C (SLI) Sub-LAN Interface

The 7798C sub-LAN interface (SLI) functions as an intelligent hub managing a network of MicroControllers and other controllers in a larger TAC I/NET™ distributed control system. The SLI provides global functions for the MicroControllers, including: Access-initiated Control, Elevator Control, Event-initiated Control, Trending, Runtime Accumulation, Automatic Time Scheduling, Calculations, Anti-passback, and periodic synchronization of the local clocks in the MicroControllers.

### FUNCTIONAL FEATURES

- Up to 6400 SLI's per TAC I/NET system
- Supports up to 32 SubLAN devices
- Built in controller LAN interface
- Provides local workstation connection
- Expanded memory 1MB for extra capacity
- Software downloadable for updates
- Purpose designed for reduced installation cost

### SPECIFICATIONS

|                                |   |
|--------------------------------|---|
| Operating voltage . . . . .    | 24 V AC                                     |
| Power consumption . . . . .    | 24 V AC, ±10%, 50/60Hz,<br>10 V A (max)     |
| Backplate dimensions . . . . . | 165 x 203 x 44mm<br>(6.50" x 8.00" x 1.75") |
| PCB dimensions . . . . .       | 203 x 244 x 6 mm<br>(8.00" x 9.63" x 0.25") |
| Channels . . . . .             | 1 sub-LAN per 7798                          |
| Controllers . . . . .          | 32 MR per sub-LAN or 16 SCUs                |

### DESCRIPTION

**7798C Controller with 1024K RAM**

### ACCESSORIES

**Recommended Power Supply XFMR6, (110V) XFMR7, (220V)  
Cable for PC-emulated HHC CBL082**



# Network Infrastructure Products





# TAC Xenta

## Network Infrastructure

- Connect the PC to the network via telephone/IP/LONWORKS® adapters
- LONWORKS® adapters connect to PC via USB/Serial port/PCI/IP
- Plug and Play network design using intelligent LONWORKS® routers and switches
- Easy to use IP to LonWorks routers make the IP network the natural backbone in the LONWORKS® network
- Network trouble shooting via the LPA
- I/Net integration to TAC Vista via Xenta 911
- High resolution local graphics in L-VIS

TAC Network infrastructure product line enables seamless integration between IP network, field buses and telephone lines. It gives a variety of methods to connect a PC to the network. It includes a gateway for I/Net to be integrated into TAC Vista. It allows for optimized LONWORKS® network design and structure also using different types of routers, both for LON to LON and IP to LON connections.

LONWORKS® network quality is improved using terminators, and can be extended via repeaters or routers. Problems on the network are detected using the Protocol analyzer.

The TAC Network infrastructure includes all necessary components to design a scalable and durable LONWORKS® network.

L-VIS is a high resolution touch-screen display used for graphical presentation and control locally on the network

| Communication Modules | Function   |                                  |                                    |  |
|-----------------------|------------|----------------------------------|------------------------------------|--|
|                       | Web Server | LonTalk Adaptor / Telephone Line | LonTalk Adaptor / Ethernet Network | LonWorks Interface / MODBUS, BACnet etc. |
| TAC Xenta 511         | ▼          |                                  | ▼                                  |  |
| TAC Xenta 901         |            | ▼                                |                                    |  |
| TAC Xenta 911         |            | ▼                                | ▼                                  |  |
| TAC Xenta 913         |            |                                  |                                    | ▼  |



## TAC Xenta 901 Serial LonTalk® Adapter

The TAC Xenta 901 is a serial LonTalk® adapter, designed to let TAC Vista reach a LONWORKS® network via a dial-up line. When the modem line between TAC Xenta 901 and TAC Vista has been established, communication proceeds as if TAC Vista had been connected directly to the LONWORKS® network. The dial-up can either be initiated by TAC Vista, or by the TAC Xenta 901 unit. TAC Xenta 901 has functions to reduce the connection cost, such as delaying a dial-up in order to collect more events, for example alarms, so that several events can be reported at the same call. It is also possible to specify dial-up to occur at a certain time of day, when the phone rates are lower.

### FUNCTIONAL FEATURES

- Works as a dial-up LonTalk® adapter
- Line blocking at a preset number of failed dial-ups
- Functions for reducing dial-up costs
- Real time clock
- Daylight saving for Europe, USA / Canada
- Configured by TAC Xenta OP Operator Panel
- All configuration data, such as telephone numbers, are stored in a non-volatile memory

Supply voltage . . . . . 24 V AC ±20%, 50 / 60 Hz or 19-40 V DC

Power consumption . . . . . max. 5 W

Ambient Temperature

Storage. . . . . -20 °C to +50 °C (-4 °F to +122 °F)

Operation. . . . . 0 °C to +50 °C (32 °F to +122 °F)

Humidity . . . . . max. 90% RH non-condensing

Real time clock

Accuracy at 25 °C (77°F) . . . . . ±12 minutes per year

Data backup. . . . . 72 h

Dimensions incl. base . . . . . 90 x 110 x 77mm  
(3.5" x 4.3" x 3")

Communication

Modem . . . . . 9600 bps, RS232A, RJ45, 8-p

Network. . . . . LONWORKS®, FTT-10, screw terminal

TAC Xenta OP . . . . . LONWORKS®, FTT-10, modular jack

For further specifications, see technical data sheet.

### DESCRIPTION

0-073-0915-0 TAC Xenta 901

0-073-0902-0 TAC Xenta 400 terminal part

0-073-0907-2 TAC Xenta OP



## TAC Xenta 911

The TAC Xenta 911 Communication device can be configured in one of two ways:

- as a LonTalk® adapter between TAC Vista and a LONWORKS® network
- as an IP modem, working as a direct replacement for a telephone modem, with dial-up functionality over the computer network

In the first case, TAC Xenta 911 is either always connected to TAC Vista, or can use the “low bandwidth” configuration to allow many more networks connected to TAC Vista.

In the latter case, TAC Xenta 911 is intended for use with most TAC units supporting dial-up (see the data sheet for TAC Xenta 911). The IP address of the “dialed-up” unit will then replace the telephone number. This makes it very easy to save money by eliminating telephone line costs. The fast dial-up time, typically less than two seconds, provides the feeling of a directly connected network.

The TAC Xenta 911 is quick to install and is easily maintained, using a web browser on the TCP/IP network. Its default values are set for TAC Xenta connection, and it is pre-configured for most TAC products.

The TAC Xenta 911 contains HTML pages providing comprehensive online help.

### FUNCTIONAL FEATURES

- Works as a LonTalk® adapter over IP between TAC Vista and a LONWORKS® network
- Supports TAC Xenta controllers and most TAC legacy products
- Configurable over an IP network with a standard web browser
- Pre-configured for most TAC products
- Real time clock
- All configuration data, such as telephone numbers, are stored in a non-volatile memory

### SPECIFICATIONS

|  |   |
|--|---|
| Supply voltage . . . . .                       | 24 V AC ±20%, 50 / 60 Hz or 19-40 V DC          |
| Power consumption . . . . .                    | max. 5 W  |
| Ambient Temperature                            |   |
| Storage . . . . .                              | -20 °C to +50 °C (-4 °F to +122 °F)             |
| Operation . . . . .                            | 0 °C to +50 °C (32 °F to +122 °F)               |
| Humidity . . . . .                             | max. 90% RH non-condensing                      |
| Real Time Clock                                |   |
| Accuracy at 25 °C (77°F) . . . . .             | ±12 minutes per year                            |
| Data backup in event of power failure. . . . . | 72 h  |
| Dimensions incl. base. . . . .                 | 90 x 110 x 77mm<br>(3.5" x 4.3" x 3")           |
| Communication                                  |   |
| Modem . . . . .                                | 2400 bps -57.6 kbps, RS232A, RJ45, 8-p (port A) |
| PC, configuration . . . . .                    | RS232A, RJ45, 4-p (port B)                      |
| Network . . . . .                              | LONWORKS®, FTT-10, screw terminal               |
| Ethernet . . . . .                             | TCP/IP, 10base-T, RJ45                          |


### DESCRIPTION

- 0-073-0831-0 TAC Xenta 911
- 0-073-0902-0 TAC Xenta 400 terminal part

### ACCESSORIES

- 0-073-0920-0 TAC Xenta: Programming Serial Kit

# Network Infrastructure

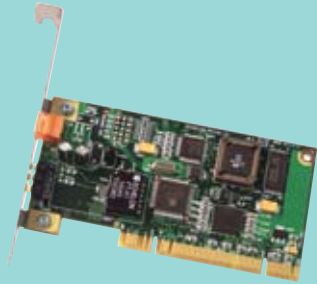

## PC LonWorks® Adapter

PC interface card for connecting the LonWorks® network to a TAC Vista central system or to a network management tool.

- Interface between LonWorks® and PC
- Half-length card for PCI slots
- Complies with LonMark® Interoperability Guidelines
- Reliable connection

### FUNCTIONAL FEATURES

- Standard PCI card
- Either for FTT-10 or TP/XF 1250

### DESCRIPTION

|              |                    |     |             |
|--------------|--------------------|-----|-------------|
| 9-073-0010-1 | PCLTA21-FTT-10     | PCI | 78 kBit/s   |
| 9-073-0011-1 | PCLTA21-TP/XF 1250 | PCI | 1250 kBit/s |



## PCMCIA LonWorks® Adapter

Interface card for connecting the LonWorks® network to a laptop using the PCMCIA interface.

- Interface between LonWorks® and PC (laptop)
- Type II PC card (PCMCIA)
- Complies with LonMark® Interoperability Guidelines
- Reliable connection


### FUNCTIONAL FEATURES

- Standard PCMCIA for Laptop
- FTT-10 as standard

### DESCRIPTION

|              |                             |           |
|--------------|-----------------------------|-----------|
| 9-073-0005-0 | PCC10 FTT-10 Interface Card | 78 kBit/s |
| 9-073-0006-0 | PCC10 Cable                 |           |

# Network Infrastructure

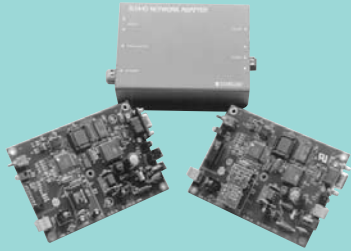

## Serial LONWORKS® Adapter

External LONWORKS® interface for serial connection between equipment such as PCs and modems and the LONWORKS® network. Can be wall mounted.

- Interface between LONWORKS® and RS-232 interface
- External device, no plug-in slot in PC necessary

### FUNCTIONAL FEATURES

- Easy access to a LonWorks network from an RS232 port
- 24 V AC/DC powered

### SPECIFICATIONS

|                   |           |   |
|-------------------|-----------|---|
| Power supply      | . . . . . | 9 - 30 V AC/DC                          |
| Power consumption | . . . . . | .250 mA                                 |
| Dimensions        | . . . . . | .138 x 101 x 34mm<br>(5.4" x 5" x 1.3") |
| Interfaces        | . . . . . | .9-pole DB-9, EIA-232                   |
| Network           | . . . . . | .LONWORKS®, FTT-10                      |

### DESCRIPTION

9-073-0012-0 SLTA-10 FTT-10



## TAC Xenta LONWORKS® Repeater FTT-10, 24 V

A passive signal amplifier for extending the maximum bus length (twisted pair) and for setting up networks with more than 64 nodes.

- Passive signal amplification
- Completely network transparent
- Modular device design via TAC Xenta 400 enclosure
- Din rail or wall mounting

### FUNCTIONAL FEATURES

- Easy mounting on DIN rail
- No configuration needed
- Extends the network
- Extends the number of nodes to 128 on a FTT-10 channel

### SPECIFICATIONS

|                        |           |                                       |
|------------------------|-----------|---------------------------------------|
| Operating voltage      | . . . . . | 24 V AC $\pm$ 20%, 50 / 60 Hz         |
| Power consumption      | . . . . . | < 1.5 VA                              |
| Approved. ambient temp | . . . . . | 0 - 50°C                              |
| Max. no. of nodes      | . . . . . | 64 (FTT-10 transceiver)               |
| Interface              | . . . . . | FTT-10, screw terminal                |
| Dimensions incl. base  | . . . . . | 90 x 110 x 77mm<br>(3.5" x 4.3" x 3") |
| Enclosure rating       | . . . . . | IP 20                                 |

For further specifications, see technical data sheet.

### DESCRIPTION

0-073-0912-0 TAC Xenta FTT-10 Repeater 24V  
0-073-0902-0 TAC Xenta 400 terminal part



## Termination

Terminating resistor for FTT-10 and TP/XF-1250 network segments.

### DESCRIPTION

0-073-0905-1 Termination FTT-10

9-073-0020-0 Termination TP/XF-1250



## TAC Xenta 913 LONWORKS®/INET Gateway

The TAC Xenta 913 is a cost-effective way to integrate a large variety of products into a TAC network. The TAC Xenta 913 supports the most commonly used open protocols, such as MODBUS, BACnet and LONWORKS®. It also supports some manufacturer-specific protocols, like I/NET and Clipsal C-bus.

The TAC Xenta 913 acts as a gateway, and transfers data point values from one network to another. Configuration is carried out using the TAC XBuilder programming tool.

### FUNCTIONAL FEATURES

- Bridges the gap between protocols
- The key to seamless integration of different vendors' systems
- Direct communication with third party products at the field level
- Migration and update of systems without replacement of older equipment

| Protocol     | Description/ Model          | Driver Description  |
|--------------|-----------------------------|---|
| BACnet       | BACnet IP / MS-TP / PTP     | BACnet is a standard protocol for building automation developed by ASHRAE. Supports BACnet ReadProperty and WriteProperty messages.<br>Max. no. of devices: IP: 10, MS-TP: 30, PTP: 10  |
| MODBUS/J-Bus | MODBUS Master / Slave / TCP | Commonly used protocol by many PLCs and other equipment manufacturers. <ul style="list-style-type: none"> <li>• Uses Poll-on-demand to extract data</li> <li>• RTU or ASCII Formats</li> <li>• Supports 01, 02, 03, 04, 05, 06 and 10 MODBUS functions</li> </ul> Max. no. of devices: As Master: 31 Slaves, As Slave: 1 Master, TCP: 100 |
| M-Bus        | Metering Bus                | M-Bus is a standard protocol for meters. Requires a hardware converter between RS-232 and M-Bus such as Level-Converter PW20 from Relay GmbH.<br>Max. no. of devices: 200   |
| C-Bus        | Clipsal bus                 | C-Bus is a proprietary communication protocol of Clipsal Lighting Control Systems.<br>Max. no. of devices: 50   |
| LONWORKS®    | FT-10                       | LONWORKS® is a standard communication, extensively used in building automation. Up to 400 SNVTs or TAC Xenta network variables.   |
| I/NET        | Host LAN / Controller LAN   | I/NET is a proprietary protocol for I/NET systems from TAC.   |



## TAC Xenta 913

### LONWORKS®/INET Gateway (continued)

#### SPECIFICATIONS

Operating voltage . . . . .24 V AC  $\pm$ 20%, 50/60 Hz or 19–40 V DC

Power consumption . . . . .max. 5 W

Transformer sizing . . . . .5 VA

Dimensions. . . . .90 x 110 x 77mm (3.5" x 4.3" x 3")

Enclosure rating . . . . .IP 20

#### Real Time Clock

Accuracy at +25°C (77° F) . . . . . $\pm$ 12 minutes per year

Power failure protection. . . . .72 h

#### Ambient Temperature

Storage. . . . .–20°C to +50°C (–4°F to +122°F)

Operation. . . . .0°C to +50°C (+32°F to +122°F)

Humidity . . . . .max. 90% RH non-condensing

#### Communication

A: RS232 . . . . .2400 – 57600 bps, RJ45, 8-p

A: RS485 . . . . .2400 – 57600 bps, async. terminal block

B: RS232 . . . . .RJ10, 4-p

C: RS485 . . . . .sync. (SDLC) terminal block

LONWORKS®. . . . .TP/FT-10, terminal block

Ethernet . . . . .TCP/IP, 10Base-T, RJ45

---

#### DESCRIPTION

0-073-0835-1 TAC Xenta 913

---

#### ACCESSORIES

0-073-0902-0 Terminal part TAC Xenta 400

0-073-0920-0 TAC Xenta: Programming Serial Kit



## NIC-PCI Network Interface

EIA-709 Network Interface with MNI (multiplexed network interface)

Supports FT-10, TP-1250/2500, RS-485

Connects to the PCI bus of a PC

Compatible with LNS, MIP, and ORION applications

---

#### DESCRIPTION

9-073-0066-0 LON® Network Interf.(NIC709-PCI)



## FUNCTIONAL FEATURES

- Supports bus and free topology termination
- TP/FT-10 side can also be used to terminate link power channels
- screw terminals (0.5 - 2.5 mm<sup>2</sup>)
- 17 L x 90 W x 58mm H (0.7" x 3.5" x 2.3")
- 1 TE DIN-rail (EN 50 022) mountable

## LONWORKS® Terminal Units

TP/FT-10, TP/LPT-10, and TP/XF-1250 networks need to be terminated using a defined network terminator. L-Term offers two standard network terminators in one slim housing, which makes them a perfect solution to be used with the active network infrastructure products (e.g. L-IP, L-Switch, etc.).

The LT-33 network terminator can be used to terminate two TP/FT-10 and TP/LPT-10 channels in bus or in free topology.

The LT-13 network terminator can be used to terminate one TP/XF-1250 and one TP/FT-10 or TP/LPT-10 channel.

| TAC Part No. | Loytec Part No. | Description                         | Alternative Description  |
|--------------|-----------------|-------------------------------------|--|
| 9-073-0068-0 | LT-33           | LON® terminal for 2 TP/FT-10, LT-33 | LON® terminal, 2 x TP/FT-10 (bus or free topology)                 |
| 9-073-0069-0 | LT-13           | LON® terminal TP-1250/-10, LT-13    | LON® terminal, 1 x TP/XF-1250, 1 x TP/FT-10 (bus or free topology) |

## DESCRIPTION

9-073-0068-0 LON® term. for 2 TP/FT-10, LT-33

9-073-0069-0 LON® term. TP-1250 /-10, LT-13



## LONWORKS® LCD Display

L-VIS impresses by its timeless design, harmonic integration into modern and historical architecture as well as its extremely user friendly concept.

Any information can be shown in a pleasing style on the high resolution 320x240 color LCD touch display. The touch display offers easy navigation through the menu structure, but is also used to set temperatures, select light scenarios, move sun blinds, or send updates to network variables in the network. Network variables are dynamically created using LNS 3.x based tools (e.g. NL-220, ALEX, LonMaker®, etc.). The LNS plug-in supplied with the unit is used to create the menu structure and to design graphical pages in no time, which can be downloaded into L-VIS via the network connection. The LCD touch display shows numbers, text, bar charts, symbols, graphics, trend logs, and many other items in a clear way.


L-VIS can also be used in a switch cabinet. It can monitor and display important system parameters like energy consumption, alarms or the temperature in cold-storage rooms. Additionally L-VIS can control devices on the network by sending out network variables.

L-VIS can be connected to a TP/FT-10 or IP-852 Ethernet channel. The unit is fully compatible with the EIA-709 and the EIA-852 standards.

### FUNCTIONAL FEATURES

- Control and display panel for LONWORKS® ANSI/EIA-709 networks
- Graphical user interface with touch display
- Clear and user friendly navigation menus
- High resolution 320x240 color LCD touch display with backlight, 256 colors (VGA)
- Representation of user defined graphics, numbers, text, bar charts, trend logs, and bitmaps
- Visualization of individual data points (NVs)
- Control of individual data points (NVs)
- Access control with PIN code
- Network ports: FT-10 and EIA-852 Ethernet (IP-852)
- Compatible with LNS applications in the fast VNI mode, e. g. NL220®, ALEX, LonMaker®
- Up to 512 input or output network variables can be processed
- Up to 512 destination addresses can be used
- Input voltage: 9-24V AC or DC
- Dimensions: W=210mm (8.3"), H=165mm (6.5"), D=60mm (2.4")

| TAC Part No. | Loytec Part No. | Description                  | Alternative Description                             |
|--------------|-----------------|------------------------------|---|
| 9-073-0070-0 | LVIS-3E100      | LON® LCD display, LVIS-3E100 | LONWORKS® LCD Display LVIS-3E100 FT-10 and Ethernet |

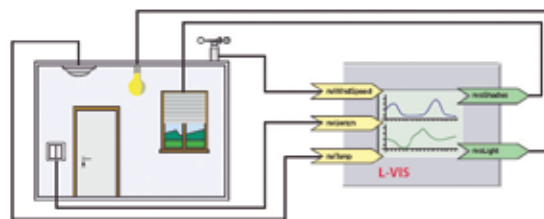

Sample L-VIS graphic

### DESCRIPTION

9-073-0070-0 LVIS-3E100



## LONWORKS® Routers

The L-Switch Router is the solution to interconnect multiple LONWORKS® (EIA-709) channels. It provides up to five ports and routes packets between these ports.

In spite of its small size the L-Switch router provides best class performance and flexibility in use. In order to provide the optimal router configuration the L-Switch supports 2 to 5 ports as well as the 2 operating modes "Smart Switch Mode" and "Configured Router Mode".

The Plug & Play installation capability of the L-Switch allows connection of L-Switch to the network without any further configuration.

The Smart Switch technology automatically detects the bit-rates of the connected channels, learns the configuration of the network (domains, subnet/node addresses, group addresses) and forwards the packets between the different ports of the L-Switch router.

### FUNCTIONAL FEATURES

- For physical separation and logical connection of up to 5 ANSI/EIA-709 network segments
- Can be used as configured router
- Can be used as learning switch or repeater
- Forwarding decision based on subnet/node and group addresses
- Processes up to 3500 packets/sec
- Supports multiple transceivers: FT-10/LPT-10, TP-1250
- Diagnostic LEDs for each channel showing network activity, overload, and error conditions
- DIN-rail (EN 50 022) or wall mountable

| TAC Part No. | Loytec Part No. | Description                       | Alternative Description            |
|--------------|-----------------|-----------------------------------|------------------------------------|
| 9-073-0038-0 | LS-33300C       | LON® Multiport switch (LS-33300C) | LS-33300CB 3 x FT-10               |
| 9-073-0039-0 | LS-13300C       | LON® Multiport switch (LS-13300C) | LS-13300CB 1 x TP-1250 / 2 x FT-10 |
| 9-073-0040-0 | LS-13333C       | LON® Multiport switch (LS-13333C) | LS-13333CB 1 x TP-1250 / 4 x FT-10 |
| 9-073-0041-0 | LS-11333C       | LON® Multiport switch (LS-11333C) | LS-11333CB 2 x TP-1250 / 3 x FT-10 |
| 9-073-0049-0 | LS-33CB         | LON® Multiport switch (LS-33CB)   | LS-33CB 2 x FT-10                  |
| 9-073-0050-0 | LS-13CB         | LON® Multiport switch (LS-13CB)   | LS-13CB 1 x TP-1250 / 1 x FT-10    |

### DESCRIPTION

9-073-0038-0 LON® Multiport switch(LS-33300C)


9-073-0039-0 LON® Multiport switch(LS-13300C)

9-073-0040-0 LON® Multiport switch(LS-13333C)

9-073-0041-0 LON® Multiport switch(LS-11333C)

9-073-0049-0 LON® Multiport switch(LS-33CB)

9-073-0050-0 LON® Multiport switch(LS-13CB)

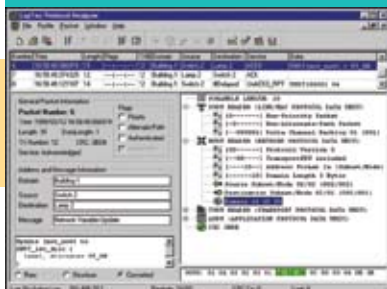

## LPA Protocol Analyzer

The family of LPA Protocol Analyzers listens on LONWORKS® (EIA-709) or LONWORKS® over IP (EIA-852) networks and displays all recorded packets on a PC screen. Thanks to its extended recording capability even intermittent faults can be detected and recorded. The interpretation of an LNS® database allows the display of meaningful node names and network variable names. Together with L-IP Internet Routers or NIC709-IP network interfaces, the LPA software can record packets even from remote network channels. The intuitive and easy to use LPA software runs on all NIC709's and the LPA-IP software runs on the NIC-852. Each LPA or LPA-IP software license must be registered for one NIC.

For remote protocol analysis, the LPA software can be registered for an NIC709-IP, and the LPA-IP software can be registered for a NIC-852 to analyze the channel behind an L-IP or a NIC709-IP. The PC running either the LPA or the LPA-IP software is connected through its Ethernet port over the Intranet/Internet/VPN with the NIC709-IPs or the L-IP routers. Up to 8 channels can be analyzed concurrently using NIC709-IPs and up to 32 channels can be analyzed using L-IPs. The software runs under Windows 2000/XP.

### LPA-SET-IP

#### FUNCTIONAL FEATURES

- Runs on Windows 2000/XP®
- Supports the LOYTEC Multiplexed Network Interface Technology (MNI)
- The LPA software supports both EIA-709 and LONMARK® IP-852 on Ethernet
- Remote LPA function with LPA-IP and L-IP
- Online packet monitoring
- High resolution packet time-stamping
- Comprehensive packet filter functions on each layer of the network protocol
- Packet interpretation down to bit-level
- Conversion of network addresses and variables into symbolic names
- Interpretation of SNVTs (Standard Network Variable Types), network management, and diagnostic messages
- LNS database interpretation
- Error tracking in packets with protocol errors
- Various forms of packet visualization
- Extensive packet statistics (short packets, CRC errors, packets/s, etc.)
- Extended packet recording capability
- Storing and exporting packet logs (e.g. to Excel spreadsheets)

#### LPA-IP

- Protocol analyzer software for EIA-852 (IP)
- NIC852 USB key for the PC

#### LPA-SET-USB

- Protocol analyzer software for EIA-852 (IP) and for EIA-709
- NIC852 USB key for the PC
- NIC709-USB key for the PC

| TAC Part No. | Loytec Part No. | Description                          |
|--------------|-----------------|--------------------------------------|
| 9-073-0046-0 | LPA-IP          | LON® protocol analyzer (LPA-IP)      |
| 9-073-0047-0 | LPA-SET-USB     | LON® protocol analyzer (LPA-SET-USB) |

#### DESCRIPTION

9-073-0046-0 LON® protocol analyzer (LPA-IP)

9-073-0047-0 LON® protocol analyzer (LPA-SET-USB)



## LONWORKS® Network Interfaces, NIC

The NIC's are the world's fastest and most universal network interfaces for LONWORKS® (EIA-709) and Ethernet (EIA-852) channels. Based on the revolutionary ORION and L-Chip technology, they offer the highest packet update rates and lowest response times on the market.

All NICs are fully compatible with legacy products, e.g. LonMaker®, NL220, ALEX, LNS 3.x applications, OPC servers, NodeUtil32, NLUtil, and with high performance ORION applications.

The multiplexed network interface (MNI) support allows, for the first time ever, multiple MIP applications to be started in parallel to an LPA or LSD Tool, or LonMaker®, or NL220 on a single network interface.

All NICs are fully compatible with legacy products, e.g. LonMaker®, NL220, ALEX, LNS 3.x applications, OPC servers, NodeUtil32, NLUtil, and with high performance ORION applications such as TAC Vista 4.4 and higher.

The NIC709-IP acts as a high performance remote network interface over the Intranet or the Internet. Secure communication between the NIC709-IP and the PC is supported by using MD5 authentication. Remote protocol analysis is supported by using the LPA-IP-SW software.

The NIC-852 supports MIP/LDV applications to access the IP-852 (Ethernet) channel without changing the application program.

### FUNCTIONAL FEATURES

- Network Interface for EIA-709 and EIA-852 (IP-852) network channels.
- Best performance, highest packet throughput.
- Use the LPA, LSD Tool, your ORION applications, MIP applications, and LNS applications on a single network interface at the same time.
- Compatible with LNS applications in high performance VNI mode e.g. LonMaker®, NL220®, ALEX.
- Compatible with MIP applications (LDV interface) e.g. NodeUtil32, NLUtil , etc.
- Compatible with high performance ORION applications (ORION API).
- Software selectable transceivers on NIC709-USB and NIC709-PCI: FT-10/LPT-10, RS-485, and TP-1250/2500.
- Runs on Windows 98/ME/2000/XP® (NIC709-USB, NIC709-PCI, NIC709-IP and NIC-852).

| TAC Part No. | Loytec Part No. | Description                         | Alternative Ports                                |
|--------------|-----------------|-------------------------------------|--|
| 9-073-0065-0 | NIC709-USB      | LONWORKS® network Interface NIC-USB | NIC709-USB USB port: FT, RS-485, TP-1250         |
| 9-073-0066-0 | NIC709-PCI      | LONWORKS® network Interface NIC-PCI | NIC709-PCI PCI bus: FT, RS-485, TP-1250          |
| 9-073-0067-0 | NIC852          | LONWORKS® network Interface EIA-852 | NIC-852 Ethernet port: IP-852 (includes USB key) |
| 9-073-0071-0 | NIC709-IP1E     | Network Interface NIC709-IP1E       | NIC709-IP1E Ethernet port: TP-1250               |

### DESCRIPTION

**9-073-0065-0** LONWORKS® network Interface NIC-USB

**9-073-0066-0** LONWORKS® network Interface NIC-PCI

**9-073-0067-0** LONWORKS® network Interface EIA-852

**9-073-0071-0** Network Interface NIC709-IP1E



## LONWORKS® (EIA-709) – IP Routers Gateway

The L-IP fills the gap between LONWORKS® (EIA-709) installations and IP networks. It can tunnel LONWORKS® packets back and forth through an arbitrary IP-based network, such as a LAN, an Intranet, or even the Internet. The L-IP connects to the IP network via an Ethernet channel. Available LONWORKS® transceivers include FT-10 and TP-1250.

The installation of an L-IP router requires little effort. The IP configuration can either be obtained via DHCP or entered manually. The user only needs to provide the IP address of an IP configuration server. If operated behind a router with network address translation (NAT or masquerading), the L-IP supports Auto-NAT to work with dynamic public IP addresses.

When using the built in IP configuration server, the user can edit and backup the IP channel configuration through the built-in web server. The configuration is stored continuously and the device operates completely standalone.

### FUNCTIONAL FEATURES

- Routes packets between ANSI/EIA-709 and IP networks (10/100MBits/s Ethernet)
- LIP-3ECTB supports one FT-10 channel, LIP-1ECTB supports one TP-1250 channel, LIP-33ECTB supports 2 FT-10 channels, LIP-3333ECTB supports 4 TP-10 channels
- Tunneling of LONWORKS® (ANSI/EIA-709) packets through IP (Ethernet) networks
- Configured Router Mode support
- Easy installation, Auto-NAT, roaming, DHCP
- Remote LPA support with LPA-IP
- Built in WEB server for LIP and IP-852 channel configuration
- SNTP support for time synchronization
- Network diagnostic LEDs

| TAC Part No. | Loytec Part No. | Description                         | Alternative Ports                        |
|--------------|-----------------|-------------------------------------|--|
| 9-073-0044-0 | LIP-1ECTB       | LONWORKS® network Interface NIC-USB | NIC709-USB USB port: FT, RS-485, TP-1250 |
| 9-073-0063-0 | LIP-3ECTB       | LON® router over IP (LIP-3ECTB)     | LIP-3ECTB 1 x Ethernet / 1 x FT-10       |
| 9-073-0064-0 | LIP-33ECTB      | LON® router over IP (LIP-33ECTB)    | LIP-33ECTB 1 x Ethernet, 2 x FT-10       |
| 9-073-0072-0 | LIP-3333ECTB    | LON® router over IP (LIP-3333ECTB)  | LIP-3333ECTB 1 x Ethernet, 4 x FT-10     |
| 9-073-0043-0 | LP-13333CT      | LON® Multiport gateway (LP-13333CT) | LIP-1333ECTB 1 x TP/XF1250, 4 x FT-10    |

### DESCRIPTION

- 9-073-0044-0 LON® router over IP (LIP-1ECTB)
- 9-073-0043-0 LON® Multiport gateway (LP-13333CT)
- 9-073-0063-0 LON® router over IP (LIP-3ECTB)
- 9-073-0064-0 LON® router over IP (LIP-33ECTB)
- 9-073-0072-0 LON® router over IP (LIP-3333ECTB)



# Operator Panels





# Xenta

## Operator Panels

- Presents variables and parameters on the network
- No configuration required
- Enables access to the entire network via a local connection
- Provides the possibility of publicly displaying data of common interest, such as the outdoor temperature

The TAC Xenta Operator Panel is a compact, and versatile display unit, which can be mounted in a cabinet or used hand-held. It provides access to values and parameters across the entire network - of particular value during installation and maintenance work. Any TAC Xenta 280/300/400 can be accessed from anywhere on the network. The user has a full overview of the installation, and the possibility to read and write parameters, time schedules and local settings.

The TAC Xenta OP 1500 is a rugged PC designed for industrial applications, and incorporates a 15" color touch screen. The OP 1500 provides a graphical presentation of the system, similar to TAC Vista graphics, without the need for a desktop PC. Installed in a public location, it can be used to control and monitor light levels, blinds and other HVAC devices, and can display suitable data in any way the user requires.

# Operator Panels



## FUNCTIONAL FEATURES

- Local access to entire network
- Intuitive navigation
- Access levels for differentiated control and supervision
- Portable and easy to plug in on any TAC Xenta 280/300/400
- Monitors variables in a TAC Xenta 100

## TAC Xenta Operator Panel

For convenient local operation of TAC Xenta controllers. Input is via 6 control keys and information is displayed in the clear LCD display. The LCD display's background lighting can be switched off if required by changing the relevant parameter. The operator panel is connected to the controller with a plug-and-socket connection and supplied with power through the cable connector. It can also be directly connected to the LonWorks® network.

The user can access all controllers connected to the network from one connection. The operator panel allows the current operating status to be checked and allows changes to be made to setpoints, time schedules etc., without connecting to a central system. In addition to allowing mobile deployment, the unit also supports the convenient plug-in installation to a TAC Xenta controller or can be mounted into the switchgear cabinet door. Modern and functional design. Compliant with TAC Xenta 100, TAC Xenta 280, TAC Xenta 300 and TAC Xenta 401.

## SPECIFICATIONS

Operating voltage . . . . . 24 V AC/DC from TAC Xenta or external  
Power consumption . . . . . max. 0.5 W  
Dimensions incl. base . . . . . 114 x 96 x 34mm (4.5" x 3.8" x 1.3")  
Protocol . . . . . FTT-10, LonTalk  
Transmission rate . . . . . 78 kbits/s

Ambient Temperature  
Storage. . . . . -20 °C to +50 °C (-4 °F to +122 °F)  
Operation. . . . . 0 °C to +50 °C (32 °F to +122 °F)  
Humidity . . . . . max. 90% RH non-condensing

Display . . . . . 4 X 20 characters alpha-numerical, backlit  
Type of protection . . . . . IP 20 / IP 43

For further specifications, see technical data sheet.

## DESCRIPTION

- 0-073-0907-2 TAC Xenta OP Operator Panel
- 0-073-0904-0 TAC Xenta OP mounting kit panel

## ACCESSORIES

- 0-073-0904-0 TAC Xenta OP mounting kit panel



# Air Handling Controllers





# TAC

## Air Handling Controllers

The TAC 2000 ventilation controller family provides a series of advanced system solutions for control, monitoring and supervision of air handling units in buildings. The software package In TAC 2000 Viewer is used to monitor and supervise the controller.

# Air Handling Controllers



## FUNCTIONAL FEATURES

- Easy to operate with clear symbols
- Complete solution in one box
- Built-in Time Scheduling: weekly and yearly programs
- Alarm handling. A and B alarms
- Pump Control energy savings
- Outdoor compensation by adjustable curve

## TAC 2411, 2412 and 2413

The TAC 2000 family now includes a series of advanced system solutions for air handling. They are complete solutions for complete control, monitoring and supervision of air handling units in buildings.

The following controllers are available:

- TAC 2411 offers a rational and efficient solution to air handling where the heating coil controls the room or supply air temperature.
- TAC 2412 has extended functionality. The room or supply air temperature is controlled in sequence using the heating coil and heat recovery.
- TAC 2413 is the most advanced controller. The room or supply air temperature is controlled in sequence using the heating coil, heat recovery and the cooling coil.

## SPECIFICATIONS

Power supply . . . . . 24 V AC  $\pm$ 20 %, 50–60 Hz

Power consumption . . . . . 3 W

Ambient Temperature

Storage. . . . . –20 °C to +50 °C (–4 °F to +122 °F)

Operation. . . . . 0 °C to +50 °C (32 °F to +122 °F)

Humidity . . . . . max. 90% RH non-condensing

Real Time Clock

Accuracy . . . . . 16 minutes/year at +25 °C (77°F)

Memory backup. . . . . 48 hours

Color . . . . . grey/red/transparent

Weight. . . . . 0.7 kg

Dimensions B x H x D . . . . . 144 x 96 x 96mm

(5.7" x 3.8" x 3.8")

Material . . . . . ABS/PC plastic

Enclosure rating . . . . . IP 40

## DESCRIPTION

200-3101-000 TAC 2411 Swedish/Finnish

200-3103-000 TAC 2411 Danish

200-3051-000 TAC 2412 Swedish/Finnish

200-3053-000 TAC 2412 Danish


200-3001-000 TAC 2413 Swedish/Finnish/English

200-3003-000 TAC 2413 Danish

## ACCESSORIES

0-073-0904-0 TAC Xenta OP mounting kit panel

# Air Handling Controllers

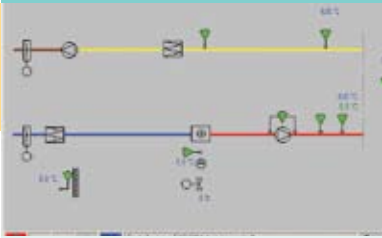

## FUNCTIONAL FEATURES

- Dynamic Colorgraphic
- Trend log viewer
- List of all parameters in the controller
- Status of In- and outputs
- Direct connection or dialed up via modem
- Windows 95 or later

## TAC 2000 Viewer

TAC 2000 Viewer is a PC-based presentation system for all controllers in the TAC 2000 Ventilation Family (TAC 2411, TAC 2412 and TAC 2413). It is an effective tool for commissioning, operation, and fault finding in air handling systems. By connecting the TAC 2000 Viewer to the controller, you can easily and quickly access all important information in the air handling system.

The tool can present information in four different forms:

- Graphical presentation of the air handling unit
- List of parameters
- Trend log data
- Status of inputs and outputs

All forms are predefined and ready to use. No expensive engineering is needed. Furthermore the information can be printed. The status of the controller, alarms and communication are displayed on the screen.

- Language: Swedish
- Modem: Hayes compatible, 4800 bps

Minimum System PC requirement:

- Windows 95 operating system
- 4 MB RAM memory
- 2 MB Hard disk
- 3.5" Diskette
- 9-D sub serial port

---

## DESCRIPTION

200-1910-000 InTA 2000V (Connector)



# Heating Controllers





# TAC

## Heating Controllers

TAC offers a series of heating controllers with and without communication possibilities. All control the radiator system according to an outdoor temperature-compensated reset curve and a reference sensor. The controllers also control the domestic hot water.

# Heating Controllers



## TAC 2112

The TAC 2112 offers control of hot water heating systems. The radiator circuit is controlled according to an outdoor temperature-compensated reset curve and reference sensor.

Simple symbols, a clear LCD display and a minimum number of buttons make it easy to read and change the values. There are three adjustable curve points where you can adjust the reset curve exactly to suit different heating systems.

### FUNCTIONAL FEATURES

- Automatic adjustment of the reset curve
- Ramp limitation of supply setpoint
- Control of room temperature via reference sensor
- Weekly program for night setback
- Separate weekly program for external equipment
- Holiday program
- Variable night setback and morning heating
- Optimized changeover from daytime operation to night setback
- Pump control with exercise function
- External setpoint adjustment (SPC control)
- Extended daytime operation and forced night setback from an external unit
- Alarm

### SPECIFICATIONS

Power supply . . . . . 24 V AC +20%, 50–60 Hz

Power consumption . . . . . 3W

Dimensions . . . . . 144 x 96 x 96mm  
(5.7" x 3.8" x 3.8")

#### Ambient Temperature

Storage . . . . . –20 °C to +50 °C  
(–4 °F to +122 °F)

Operation . . . . . 0 °C to +50 °C (32 °F to +122 °F)

Humidity . . . . . max. 90% RH non-condensing

#### Real Time Clock

Accuracy at +25°C (77° F) . . . . . ±12 minutes/year

Backup memory . . . . . 48 hours

#### Thermistor Inputs

Type of thermistor . . . . . 1800 ohm/ 25°C (+77° F)

Measurement range . . . . . –50°C to +120°C  
(–58° F to + 248° F)

#### Relay Outputs

Max. voltage . . . . . 250 V AC

Max. current . . . . . 2 A

#### Inputs

Sensor inputs B1-B4, U1, U4 thermistor input (see above)

Setpoint adjustment (SPC), U2 . . . . . 0–10 V DC

Additional connection to outdoor temp., Y2 0–10 V DC

Enclosure rating . . . . . IP 40, front IP 54

### DESCRIPTION

200-2201-000 TAC 2112 Swedish Controller

200-2202-000 TAC 2112 Danish Controller

200-2203-000 TAC 2112 Swedish/Finnish Controller

200-2204-000 TAC 2112 GB Controller

# Heating Controllers



## TAC 2222

The TAC 2222 offers combined heating and domestic hot water control for hot water heating systems. The radiator circuit is controlled according to an outdoor temperature compensated reset curve and reference sensor. The domestic hot water is controlled by using a separate constant temperature controller.

Simple symbols, a clear LCD display and a minimum number of buttons make it easy to read and change the values. There are three adjustable curve points where you can adjust the reset curve exactly to suit different heating systems. A reference sensor is used to adjust the reset curve and the duration and the night setback automatically. Adjustments resulting from seasonal variations are automatic.

### FUNCTIONAL FEATURES

- Automatic adjustment of the reset curve
- Ramp limitation of supply setpoint
- Control of room temperature via a reference sensor
- Weekly program for night setback
- Separate weekly program for domestic hot water and external unit
- Holiday program for heating and domestic hot water
- Variable night setback and morning heating
- Optimized changeover from daytime operation to night setback
- Separate limitation of return temperature of heating and domestic hot water
- Pump control with exercise function
- Heat control using an external unit (SPC control)
- Extended daytime operation and forced night setback from an external unit
- Domestic hot water control
- Alarm

### SPECIFICATIONS

|   |   |
|---|---|
| Power supply . . . . .                            | 24 V AC +20%, 50-60 Hz                    |
| Power consumption . . . . .                       | 3W  |
| Dimensions . . . . .                              | 144 x 96 x 96mm<br>(5.7" x 3.8" x 3.8")   |
| Ambient Temperature                               |   |
| Storage . . . . .                                 | -20 °C to +50 °C<br>(-4 °F to +122 °F)    |
| Operation . . . . .                               | 0 °C to +50 °C (32 °F to +122 °F)         |
| Humidity . . . . .                                | max. 90% RH non-condensing                |
| Real Time Clock                                   |   |
| Accuracy at +25°C (77°F) . . . . .                | +12 minutes/year                          |
| Backup memory . . . . .                           | 48 hours                                  |
| Enclosure rating . . . . .                        | IP 40, front IP 54                        |
| Thermistor Inputs                                 |   |
| Type of thermistor . . . . .                      | 1800 ohm/25 °C (+77°F)                    |
| Measurement range . . . . .                       | -50 °C to +120 °C<br>(-58° F to + 248° F) |
| Relay Outputs                                     |   |
| Max. voltage . . . . .                            | 250 V AC                                  |
| Max. current . . . . .                            | 2 A                                       |
| Inputs  |   |
| Sensor inputs B1-B4, thermistor input (see above) |   |
| Heat adjustment (SPC) . . . . .                   | 0-10 V DC                                 |
| Domestic hot water valve . . . . .                | 0-10 V DC or 2-10 V DC                    |
| Additional connection to outdoor temp . . . . .   | 0-10 V DC                                 |

### DESCRIPTION

- 200-2051-000 TAC 2222 Swedish Controller
- 200-2052-000 TAC 2222 GB Controller
- 200-2053-000 TAC 2222 Danish Controller
- 200-2054-000 TAC 2222 Swedish/Finnish Controller

# Heating Controllers



## TAC 2232 District Heating Compensator/ Optimizer

The TAC 2232 offers combined heating and domestic hot water control for hot water heating systems. The controller is intended for three stage district heating. The radiator circuit is controlled according to an outdoor temperature-compensated reset curve and reference sensor. The domestic hot water is controlled by using a separate constant temperature controller.

### FUNCTIONAL FEATURES

- Automatic adjustment of the reset curve
- Ramp limitation of supply setpoint
- Control of room temperature via reference sensor
- Weekly program for night setback
- Separate weekly program for domestic hot water and external unit
- Holiday program for heating and domestic hot water
- Variable night setback and morning heating
- Optimized changeover from daytime operation to night setback
- Temperature limitation from the radiator circuit
- Pump control with exercise function
- Heat control using an external unit (SPC control)
- Extended daytime operation and forced night setback from an external unit
- Domestic hot water control
- Alarm
- Automatic adjustments resulting from seasonal variations

### SPECIFICATIONS

Power supply . . . . . 24 V AC +20%, 50-60 Hz  
Power consumption . . . . . 3W  
Dimensions . . . . . 144 x 96 x 96mm (5.7" x 3.8" x 3.8")

#### Ambient Temperature

Storage . . . . . -20 °C to +50 °C (-4 °F to +122 °F)  
Operation . . . . . 0 °C to +50 °C (32 °F to +122 °F)  
Humidity . . . . . max. 90% RH non-condensing

#### Real Time Clock

Accuracy at +25°C (77°F) . . . . . ±12 minutes/year  
Backup memory . . . . . 48 hours  
Enclosure rating . . . . . IP 40, front IP 54

#### Thermistor Inputs

Type of thermistor . . . . . 1800 ohm/25°C (+77°F)  
Measurement range . . . . . -50°C to +120°C (-58° F to + 248° F)

#### Relay Outputs

Max. voltage . . . . . 250 V AC  
Max. current . . . . . 2 A

#### Inputs

Sensor inputs B1-B4 . . . . . thermistor input (see above)  
Heat adjustment (SPC), U2 . . . . . 0-10 V DC  
Domestic hot water valves . . . . . 0-10 V DC or 2-10 V DC

### DESCRIPTION

200-2301-000 TAC 2232 Controller, incl. Swedish documentation

# Heating Controllers



## TAC 2242 Heating Compensator/ Optimizer

The TAC 2242 offers combined heating and domestic hot water control for hot water heating systems. The radiator circuit is controlled according to an outdoor temperature compensated reset curve and reference sensor. The domestic hot water is controlled by using a separate constant temperature controller.

### FUNCTIONAL FEATURES

- Automatic adjustment of the reset curve
- Ramp limitation of supply setpoint
- Control of room temperature via reference sensor
- Weekly program for night setback
- Separate weekly program for domestic hot water and external unit
- Holiday program for heating and domestic hot water
- Variable night setback and morning heating
- Optimized changeover from daytime operation to night setback
- Separate limitation of return temperature of heating and domestic hot water
- Pump control with exercise function
- Heat control using an external unit (SPC control)
- Extended daytime operation and forced night setback from an external unit
- Domestic hot water control
- Alarm

Simple symbols, a clear LCD display and a minimum number of buttons make it easy to read and change the values. There are three adjustable curve points where you can adjust the reset curve exactly to suit different heating systems. A reference sensor is used to adjust the reset curve and the duration and the night setback automatically. Adjustments resulting from seasonal variations are automatic.

### SPECIFICATIONS

|                              |   |
|------------------------------|---|
| Power supply . . . . .       | 24 V AC +20%, 50-60 Hz                  |
| Power consumption . . . . .  | 3W                                      |
| Overall dimensions . . . . . | 144 x 96 x 96mm<br>(5.7" x 3.8" x 3.8") |

#### Ambient Temperature

|                   |  |
|-------------------|--|
| Storage . . . . . | -20 °C to +50 °C<br>(-4 °F to +122 °F) |
|-------------------|--|

|                     |                                      |
|---------------------|--------------------------------------|
| Operation . . . . . | 0 °C to +50 °C<br>(32 °F to +122 °F) |
|---------------------|--------------------------------------|

|                    |                            |
|--------------------|----------------------------|
| Humidity . . . . . | max. 90% RH non-condensing |
|--------------------|----------------------------|

#### Real Time Clock

|                                    |                    |
|------------------------------------|--------------------|
| Accuracy at +25°C (77°F) . . . . . | ±12 minutes/year   |
| Backup memory . . . . .            | 48 hours           |
| Enclosure rating . . . . .         | IP 40, front IP 54 |

#### Thermistor Inputs

|                              |   |
|------------------------------|---|
| Type of thermistor . . . . . | 1800 ohm/25 °C (+77°F)                  |
| Measurement range . . . . .  | -50°C to +120°C<br>(-58° F to + 248° F) |

#### Relay Outputs

|                        |          |
|------------------------|----------|
| Max. voltage . . . . . | 250 V AC |
| Max. current . . . . . | 2 A      |

#### Inputs

|  |                        |
|--|------------------------|
| Sensor inputs B1-B4 thermistor input (see above) |                        |
| Heat adjustment (SPC) . . . . .                  | 0-10 V DC              |
| Domestic hot water valve . . . . .               | 0-10 V DC or 2-10 V DC |
| Additional connection to outdoor temp. . . . .   | 0-10 V DC              |

### DESCRIPTION

200-2455-000 TAC 2242 Controller

# Heating Controllers



## TAC 2321 District Heating Compensator

The TAC 2321 offers combined heating and domestic hot water control for district heating systems. The radiator circuit is controlled according to an outdoor temperature compensated reset curve and reference sensor. The domestic hot water is controlled by using a separate loading controller.

Simple symbols, a clear LCD display and a minimum number of buttons make it easy to read and change the values. The reset curve has four adjustable curve points which mean that you can adjust it exactly to suit different heating systems. A reference sensor is used to adjust the reset curve and the duration and magnitude of the night setback automatically. Adjustments resulting from seasonal variations are fully automatic.

### FUNCTIONAL FEATURES

- Automatic adjustment of the reset curve
- Ramp limitation of supply setpoint
- Control of room temperature via reference sensor
- Weekly program for night setback
- Separate weekly program for domestic hot water and hot water circulation pump
- Weekend program for heating and domestic hot water
- Variable night setback and morning heating
- Optimized changeover from daytime operation to night setback and vice versa
- Separate limitation of return temperature of heating and domestic hot water
- Pump control with exercise function
- Heat adjustment from a remote control unit (accessory)
- Extended daytime operation and forced night setback from an external unit, or from the panel
- Domestic hot water control with adjustable high temperature function (to eliminate the risk of legionella)
- Power limitation
- Alarm

### SPECIFICATIONS

Power supply . . . . . 230 V AC  $\pm 10\%$ , 50–60 Hz  
Power consumption . . . . . 5W  
Overall dimensions . . . . . 144 x 96 x 96mm (5.7" x 3.8" x 3.8")

#### Real Time Clock

Accuracy at +25°C (77° F) . . . . .  $\pm 12$  minutes/year  
Backup memory . . . . . 48 hours  
Enclosure rating . . . . . IP 40, front IP 54

#### Ambient Temperature

Operating . . . . . 0°C to +50°C (32°F to +122 °F)  
Storage . . . . . -20°C to +50°C (-4°F to +122 °F)  
Ambient humidity . . . . . max. 90% RH non-condensing

#### Thermistor Inputs

Thermistor type . . . . . 1800 ohm/25 °C (77 ° F)  
Measurement range . . . . . -30°C to +120°C (-22°F to +248°F)

#### Relay Outputs

Max. voltage . . . . . 250 V AC  
Max. current . . . . . 2 A


#### Inputs

Sensor inputs - thermistor input (see above)  
Remote control unit . . . . . 0–10 V DC  
Dom. hot water valve . . . . . 0–10 V DC or 2–10 V DC  
Additional connection to outdoor temp., Y2 0–10 V DC

### DESCRIPTION

200-2103-000 TAC 2321 Controller

# Heating Controllers

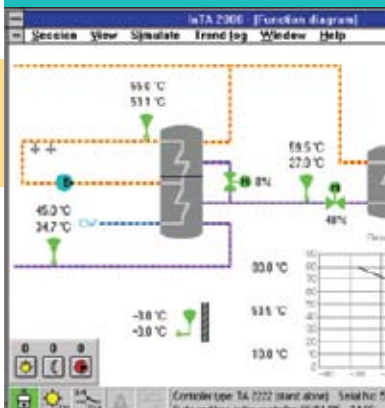

## FUNCTIONAL FEATURES

- Dynamic Colorgraphic
- Trend log viewer
- List of all parameters in the controller
- Status of In- and outputs
- Direct connection or dialed up via modem
- Windows™ 95 or later

## TAC 2000 Viewer for TAC 2000 Heating Controllers

TAC 2000 is a PC-based information tool intended for commissioning, operation and troubleshooting in heating systems with controllers belonging to the TAC 2000 family. By connecting a PC running TAC 2000 Viewer to a TAC 2000 controller, you get a quick and clear overview of the controller and the controlled heating application. All measured and setpoint values are shown in clear function diagrams. The controller's parameters are shown together with its reset curves in clear forms. The pictures and forms are complete, which saves time, since you do not need to configure anything or work on the picture layout.

The TAC 2000 Viewer supports the TAC 2112, 2222, 2242, and 2321 controllers.

- Language: Swedish, English, German
- Modem: Hayes compatible, 4800 bps

System requirements, PC

- Windows™ 95 or later
- Min. 4 MB Internal memory
- Min. 2 MB Hard disk space
- One 3 1/4" diskette drive
- One 9 pin serial port

## DESCRIPTION

200-1900-000 InTA 2000 (Connector)



# Heating Controllers



## TAC 200 Reset Controller

TAC 200 is an Outdoor Reset Controller for outdoor reset control of heating systems. It can be used for conventional supply temperature control of mixing valve systems for radiator or floor heating. It can also be used for two or three stage on/off control of gas boilers.

With a room sensor, automatic reset of the supply temperature from the room temperature can be obtained. Great flexibility in adjusting the reset curve – a number of curves are available for each individual application – enables optimum matching to the pertinent heating system.

The TAC 200 has high and low limits for the supply temperature. Reading and adjusting values is easy thanks to a display window and push buttons on the front of the controller.

### FUNCTIONAL FEATURES

- Outdoor reset control
- Control of mixing valve systems for radiator or floor heating.
- Functions for two or three stage on/off control of gas boilers.
- Night setback and morning boost
- Pump control
- Day and week scheduling
- Daylight saving function
- Easy program selection with dip switches

### SPECIFICATIONS

Power supply voltage . . . . . 220-230 V AC  $\pm 10\%$ , 50-60Hz  
Power consumption . . . . . 2 VA  
Dimensions . . . . . 144 x 96 x 96mm (5.7" x 3.8" x 3.8")

#### Real Time Clock

Accuracy . . . . . max. dev. 12 min./year at +25 °C (77 ° F)  
Backup memory . . . . . 12 hours

#### Ambient Temperature

Operation . . . . . 0 °C to +50 °C (32 °F to 122 ° F)  
Storage . . . . . -20 °C to +50 °C (-4 °F to 77 °F)  
Ambient humidity . . . . . max. 90% RH, non-condensing  
Protection . . . . . IP 40  
Application selection . . . . . DIP switch with 8 switches

#### Digital Inputs

Quantity . . . . . 3

#### Analog Inputs

Quantity . . . . . 3  
Thermistor type . . . . . 1800 ohm/25 °C (77 ° F)

#### Relay Outputs

Quantity . . . . . 4  
Function . . . . . making (NO)  
Voltage rating . . . . . max. 250 V AC  
Load rating . . . . . 2 A, min. 50 mA at 24 V

### DESCRIPTION

- 200-1000-000 TAC 200
- 200-1001-000 TAC 200 wo back
- 200-1002-000 Wall mounting unit TAC 200
- 200-1003-000 TAC 200 V

# Heating Controllers



## TAC 200 OPT Heating Compensator and Optimizer

TAC 200 OPT is a heating compensator complete with optimizer control of the boiler. It can be used for conventional supply temperature control of mixing valve systems for radiator or floor heating. It can also be used for two stage on/off control of gas boilers.

### FUNCTIONAL FEATURES

- Outdoor-reset control
- Automatic calculation of the reset curve from a room sensor
- Control of mixing valve systems for radiator or floor heating
- Functions for two or three stage on/off control of gas boilers
- Night setback and morning boost
- Pump control
- Day and week scheduling
- Daylight saving function
- Easy program selection with dip switches

With a room sensor, automatic reset of the supply temperature from the room temperature can be obtained. Great flexibility in adjusting the reset curve – a number of curves are available for each individual application – enables optimum matching to the pertinent heating system. TAC 200 OPT has high and low limits for the supply water temperature.

The controller has a built-in safety function with three stages of frost protection. Reading and adjusting values is easy thanks to a display window and push buttons on the front of the controller.

### SPECIFICATIONS

Power supply voltage . . . . . 220–230 V AC±10%, 50–60 Hz  
Power consumption . . . . . 2 VA  
Dimensions . . . . . 14 x 96 x 96mm (5.7" x 3.8" x 3.8")

#### Real Time Clock

Accuracy . . . . . max. dev. 12 min./year at +25°C (77°F)  
Backup memory . . . . . 12 hours

#### Ambient Temperature

Operation . . . . . 0 to +50 °C (32 to +77°F)  
Storage . . . . . –20 to +50 °C (-4 to +122°F)  
Ambient humidity . . . . . max. 90% RH, non-condensing  
Protection . . . . . IP 40  
Application selection . . . . . DIP-switch with 8 switches

Digital inputs . . . . . 2

Analog inputs . . . . . 3

Thermistor type . . . . . 1800 ohm/25 °C (77°F)

#### Relay Outputs

Number of outputs . . . . . 4  
Function . . . . . making (NO)  
Voltage rating . . . . . max. 250 V AC  
Load rating . . . . . 2 A, min. 50 mA at 24 V

### DESCRIPTION

200-1005-000 TAC 200 OPT

# Heating Controllers



## FUNCTIONAL FEATURES

- Controller for domestic hot water
- Output 2-10V or 0-10V
- SPC input for remote setpoint adjustment

## TAC 239W Domestic Hot Water Temperature Controller

The TAC 239W controller is part of the C80 system and is designed for the control of domestic hot water systems. The output is a 2–10 V or a 0–10 V signal, which can position one or up to 10 actuators of the EM type in parallel. The setpoint can be increased or decreased via the SPC input.

For best results, the TAC 239W should be used in combination with a fast temperature sensor.

## SPECIFICATIONS

Supply voltage . . . . . 16 V DC  $\pm 0.4$  V, 24 V AC  $\pm 20\%$ ,  
50–60 Hz

Power consumption . . . . . max. 25 mA

Dimensions . . . . . 127 x 54 x 74mm

Temperature sensor . . . . . 1800 ohm/25 °C (77 ° F)

### Control Output Y

Output voltage . . . . . 2–10 V or 0–10 V, direct acting

Load . . . . . max 2 mA; max. 10 control  
inputs, short circuit proof

### Control Input Z1

Permitted voltage. . . . . max. 16 V DC

Input current . . . . . max. 0.1 mA

### Ambient Temperature

Operation. . . . . 0 to +50°C (32 to +122 ° F)

Storage. . . . . –40 to +50°C (–40 to +122 ° F)

Ambient humidity . . . . . max. 90% RH

### Enclosure Rating

Cover . . . . . IP 54 (similar to NEMA 13)

Terminals . . . . . IP 31 (similar to NEMA 1)

## DESCRIPTION

239-1010-800 TAC 239W with cassette and terminal block

---

Copyright © 2007, TAC  
All brand names, trademarks and registered trademarks  
are the property of their respective owners. Information  
contained within this document is subject to change without  
notice. All rights reserved.

CAT-VISTA-A4  
09/2007



[www.tac.com](http://www.tac.com)

